


Berry Wastewater Treatment Plant - Monitoring Summary
 Licensee: Shoalhaven City Council, Shoalhaven Water, PO Box 42, Nowra 2541
 Environment Protection Licence No 1736



EPA ID No. 3


BOD

Frequency	Date Sample Obtained	Date Result Obtained	Unit Of Measurement	100 percentile limit	Council Sample
Monthly	05-Jun-13	20-Jun-13	milligrams per litre	20	<2
Monthly	03-Jul-13	12-Jul-13	milligrams per litre	20	<2
Monthly	07-Aug-13	14-Aug-13	milligrams per litre	20	<2
Monthly	04-Sep-13	13-Sep-13	milligrams per litre	20	<2
Monthly	02-Oct-13	11-Oct-13	milligrams per litre	20	<2
Monthly	06-Nov-13	14-Nov-13	milligrams per litre	20	<2
Monthly	04-Dec-13	18-Dec-13	milligrams per litre	20	<2
Monthly	15-Jan-14	28-Jan-14	milligrams per litre	20	3
Monthly	05-Feb-14	19-Feb-14	milligrams per litre	20	<2
Monthly	05-Mar-14	17-Mar-14	milligrams per litre	20	<2
Monthly	09-Apr-14	23-Apr-14	milligrams per litre	15	<2
Monthly	07-May-14	19-May-14	milligrams per litre	15	<2

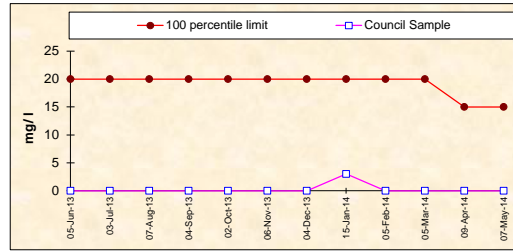


TOTAL NITROGEN

Frequency	Date Sample Obtained	Date Result Obtained	Unit Of Measurement	100 percentile limit	Council Sample
Monthly	05-Jun-13	20-Jun-13	milligrams per litre	15	3.0
Monthly	03-Jul-13	12-Jul-13	milligrams per litre	15	2.2
Monthly	07-Aug-13	14-Aug-13	milligrams per litre	15	2.6
Monthly	04-Sep-13	13-Sep-13	milligrams per litre	15	3.4
Monthly	02-Oct-13	11-Oct-13	milligrams per litre	15	2.4
Monthly	06-Nov-13	14-Nov-13	milligrams per litre	15	2.9
Monthly	04-Dec-13	18-Dec-13	milligrams per litre	15	3.2
Monthly	15-Jan-14	28-Jan-14	milligrams per litre	15	2.0
Monthly	05-Feb-14	19-Feb-14	milligrams per litre	15	3.0
Monthly	05-Mar-14	17-Mar-14	milligrams per litre	15	2.8
Monthly	09-Apr-14	23-Apr-14	milligrams per litre	15	20.5
Monthly	07-May-14	19-May-14	milligrams per litre	15	3.4

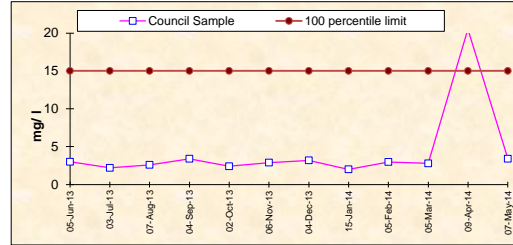


OIL AND GREASE

Frequency	Date Sample Obtained	Date Result Obtained	Unit Of Measurement	100 percentile limit	Council Sample
Monthly	05-Jun-13	07-Jun-13	milligrams per litre	10	<1
Monthly	03-Jul-13	12-Jul-13	milligrams per litre	10	<1
Monthly	07-Aug-13	14-Aug-13	milligrams per litre	10	<1
Monthly	04-Sep-13	13-Sep-13	milligrams per litre	10	<1
Monthly	02-Oct-13	11-Oct-13	milligrams per litre	10	<1
Monthly	06-Nov-13	14-Nov-13	milligrams per litre	10	<1
Monthly	04-Dec-13	18-Dec-13	milligrams per litre	10	<1
Monthly	15-Jan-14	28-Jan-14	milligrams per litre	10	<1
Monthly	05-Feb-14	19-Feb-14	milligrams per litre	10	<1
Monthly	05-Mar-14	17-Mar-14	milligrams per litre	10	<1
Monthly	09-Apr-14	23-Apr-14	milligrams per litre	10	<1
Monthly	07-May-14	19-May-14	milligrams per litre	10	<1

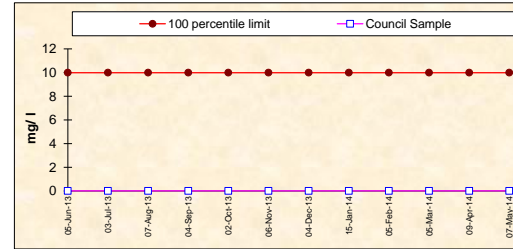

TOTAL PHOSPHORUS

Frequency	Date Sample Obtained	Date Result Obtained	Unit Of Measurement	100 percentile limit	Council Sample
Monthly	05-Jun-13	20-Jun-13	milligrams per litre	5	1.1
Monthly	03-Jul-13	12-Jul-13	milligrams per litre	5	0.5
Monthly	07-Aug-13	14-Aug-13	milligrams per litre	5	0.9
Monthly	04-Sep-13	13-Sep-13	milligrams per litre	5	2.0
Monthly	02-Oct-13	11-Oct-13	milligrams per litre	5	0.8
Monthly	06-Nov-13	14-Nov-13	milligrams per litre	5	3.0
Monthly	04-Dec-13	18-Dec-13	milligrams per litre	5	2.3
Monthly	15-Jan-14	28-Jan-14	milligrams per litre	5	2.0
Monthly	05-Feb-14	19-Feb-14	milligrams per litre	5	1.5
Monthly	05-Mar-14	17-Mar-14	milligrams per litre	5	2.2
Monthly	09-Apr-14	23-Apr-14	milligrams per litre	1	1.3
Monthly	07-May-14	19-May-14	milligrams per litre	1	0.0

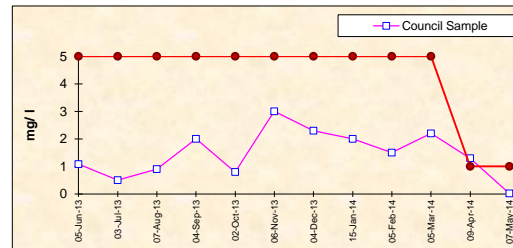

TOTAL SUSPENDED SOLIDS

Frequency	Date Sample Obtained	Date Result Obtained	Unit Of Measurement	100 percentile limit	Council Sample
Monthly	05-Jun-13	20-Jun-13	milligrams per litre	30	2
Monthly	03-Jul-13	12-Jul-13	milligrams per litre	30	<1
Monthly	07-Aug-13	14-Aug-13	milligrams per litre	30	<1
Monthly	04-Sep-13	13-Sep-13	milligrams per litre	30	<1
Monthly	02-Oct-13	11-Oct-13	milligrams per litre	30	<1
Monthly	06-Nov-13	14-Nov-13	milligrams per litre	30	2
Monthly	04-Dec-13	18-Dec-13	milligrams per litre	30	<1
Monthly	15-Jan-14	28-Jan-14	milligrams per litre	30	1
Monthly	05-Feb-14	19-Feb-14	milligrams per litre	30	<1
Monthly	05-Mar-14	17-Mar-14	milligrams per litre	30	<1
Monthly	09-Apr-14	23-Apr-14	milligrams per litre	15	1
Monthly	07-May-14	19-May-14	milligrams per litre	15	2

