




DETAIL 1 - REMOTE LEVEL SENSOR UNIT DETAILED PLAN

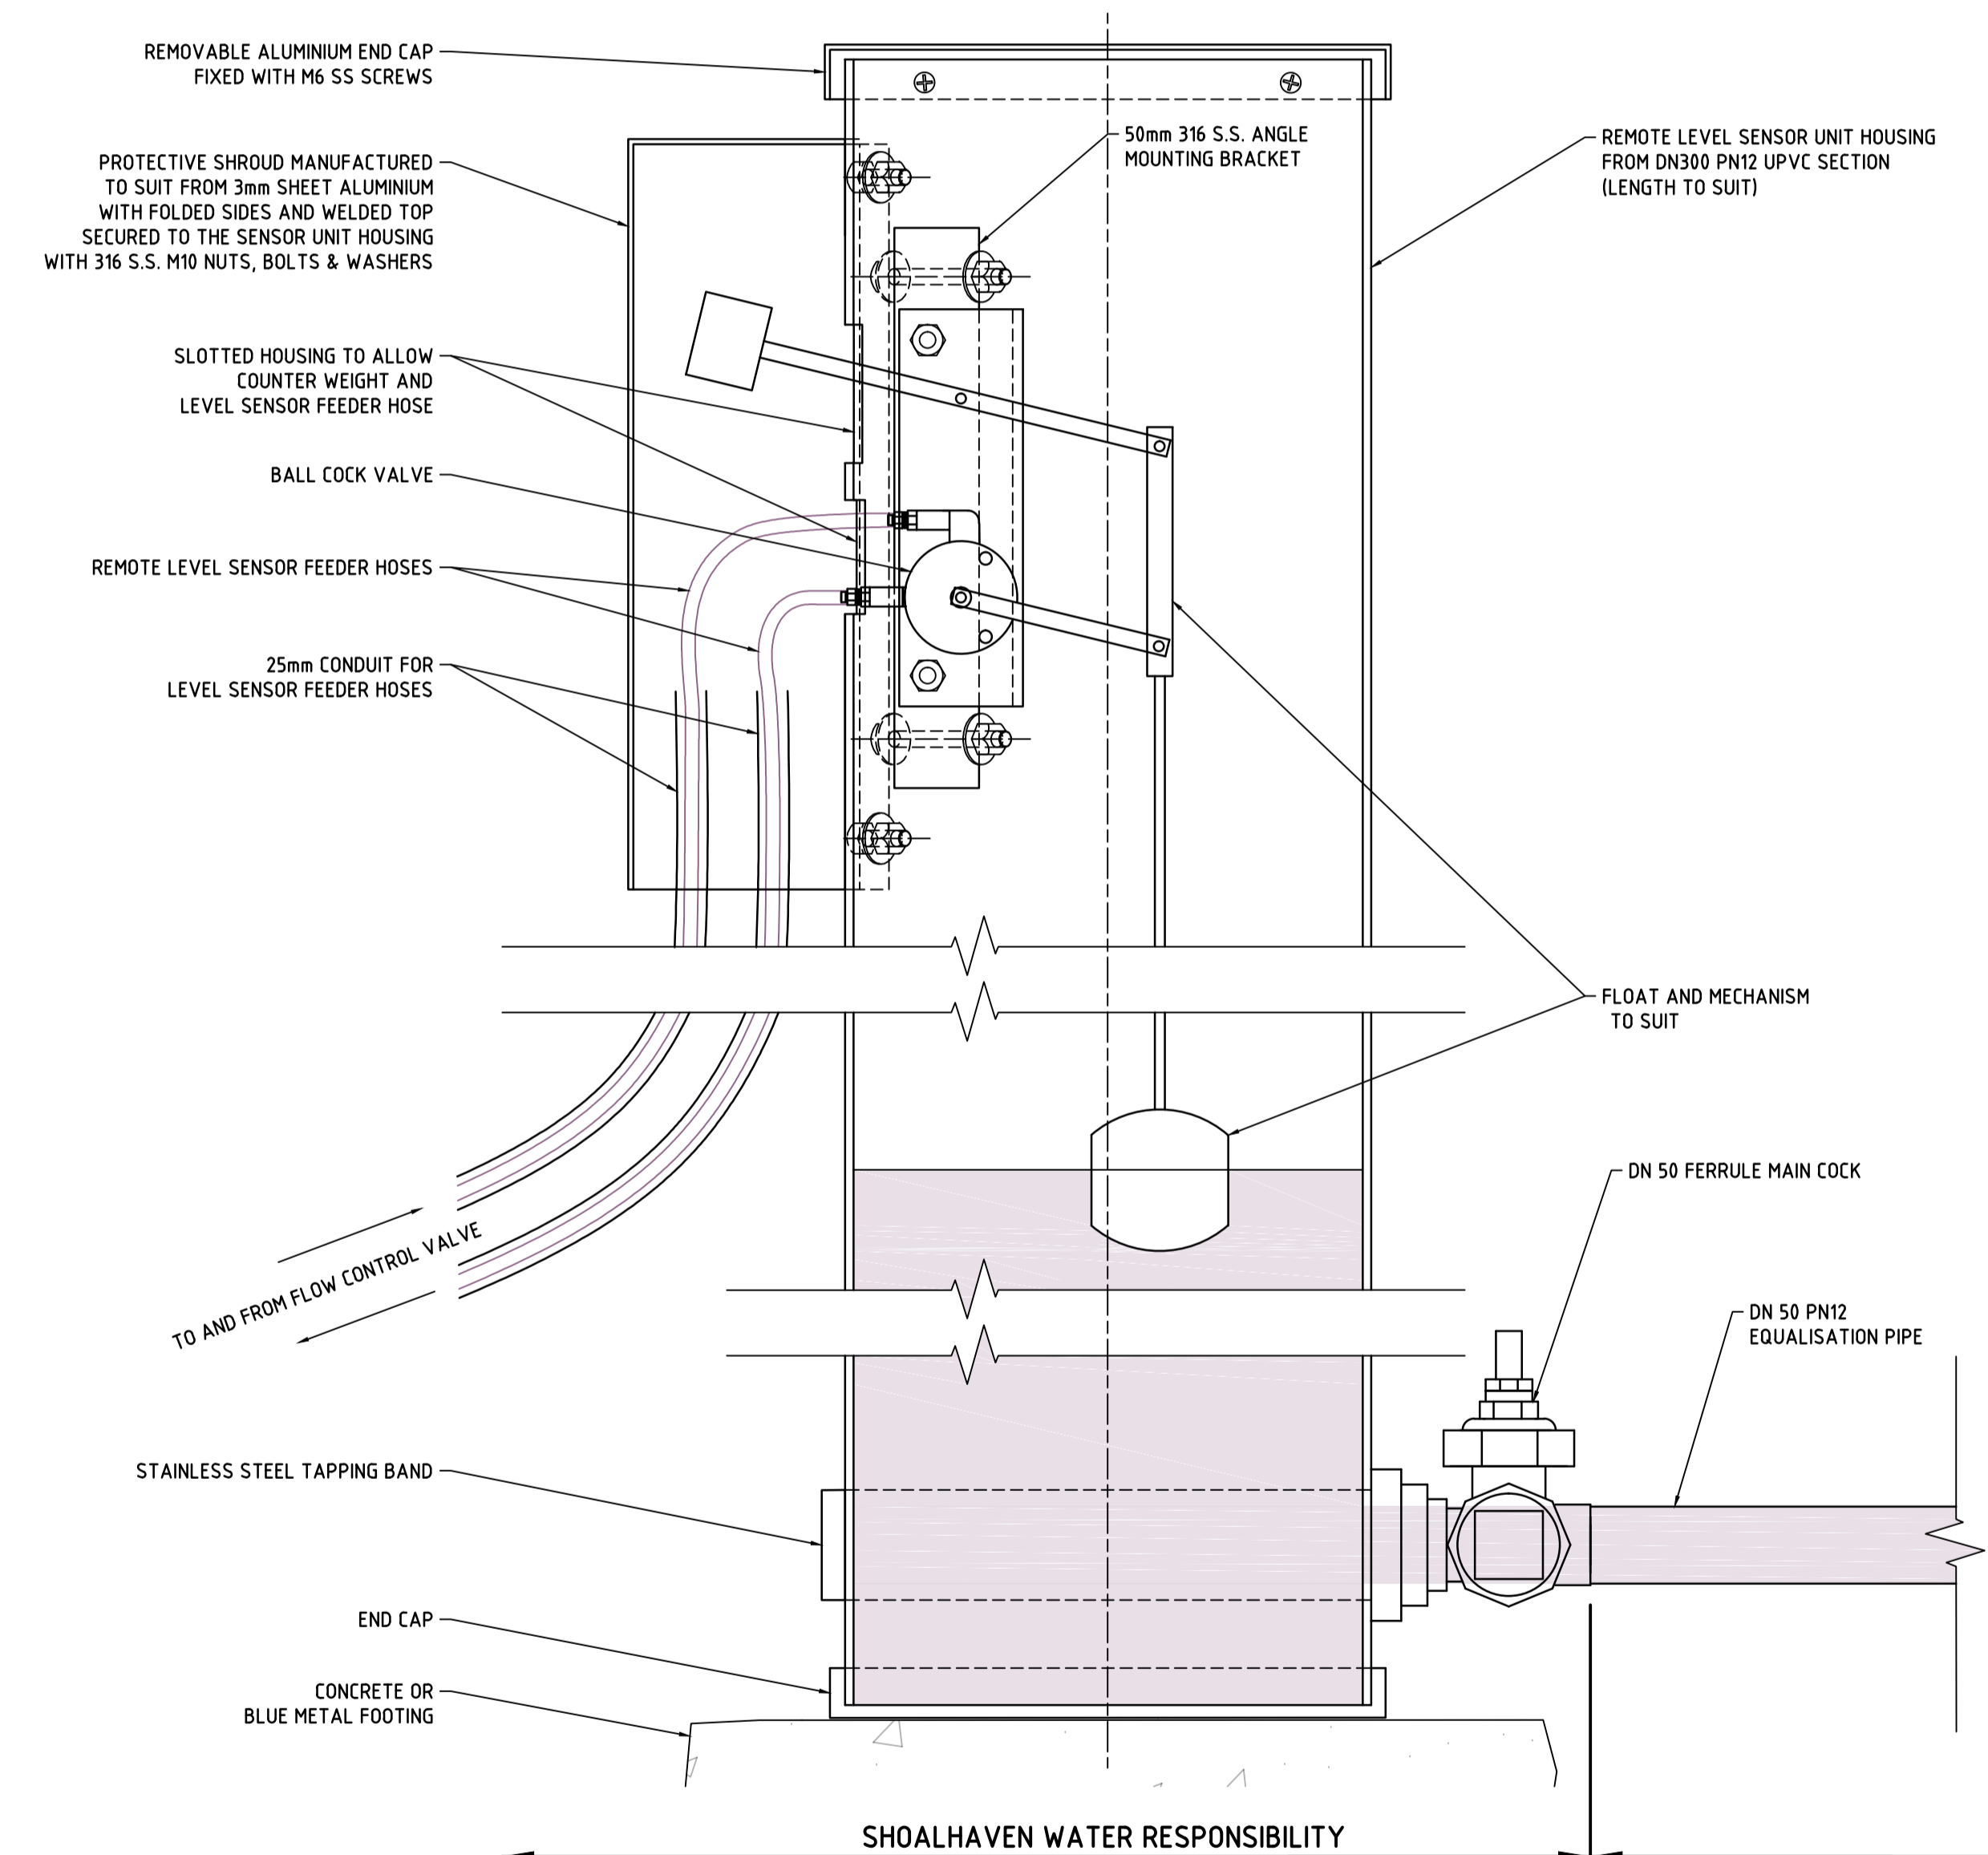

DETAIL 1 - REMOTE LEVEL SENSOR UNIT SECTION A-A

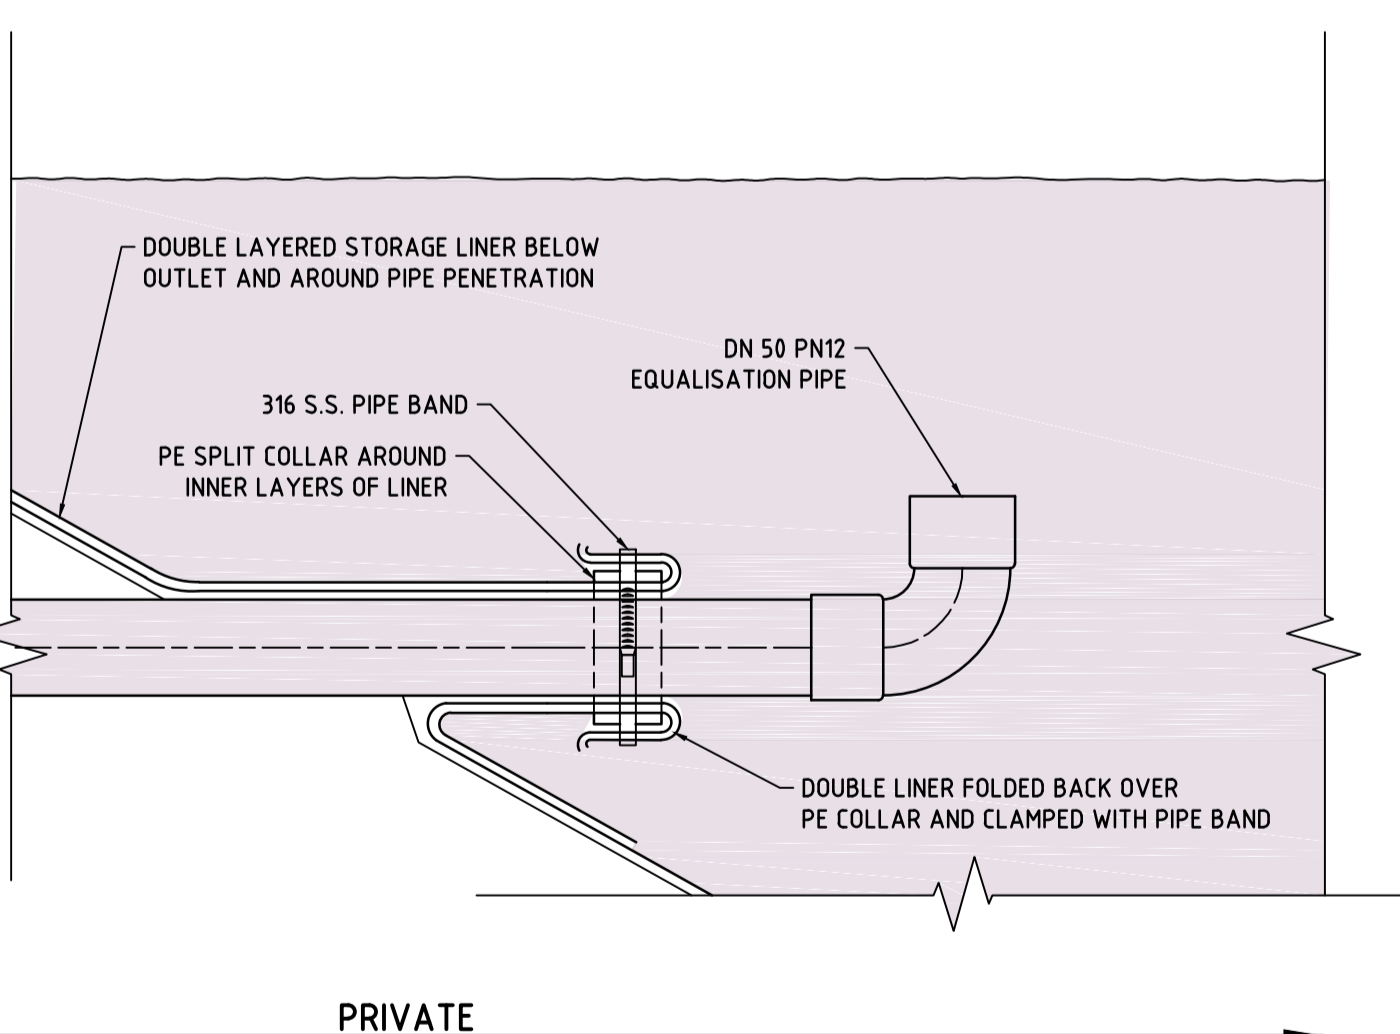

DETAIL 2 - DAM LINER PENETRATION OF EQUALISATION PIPE DETAILED ELEVATION

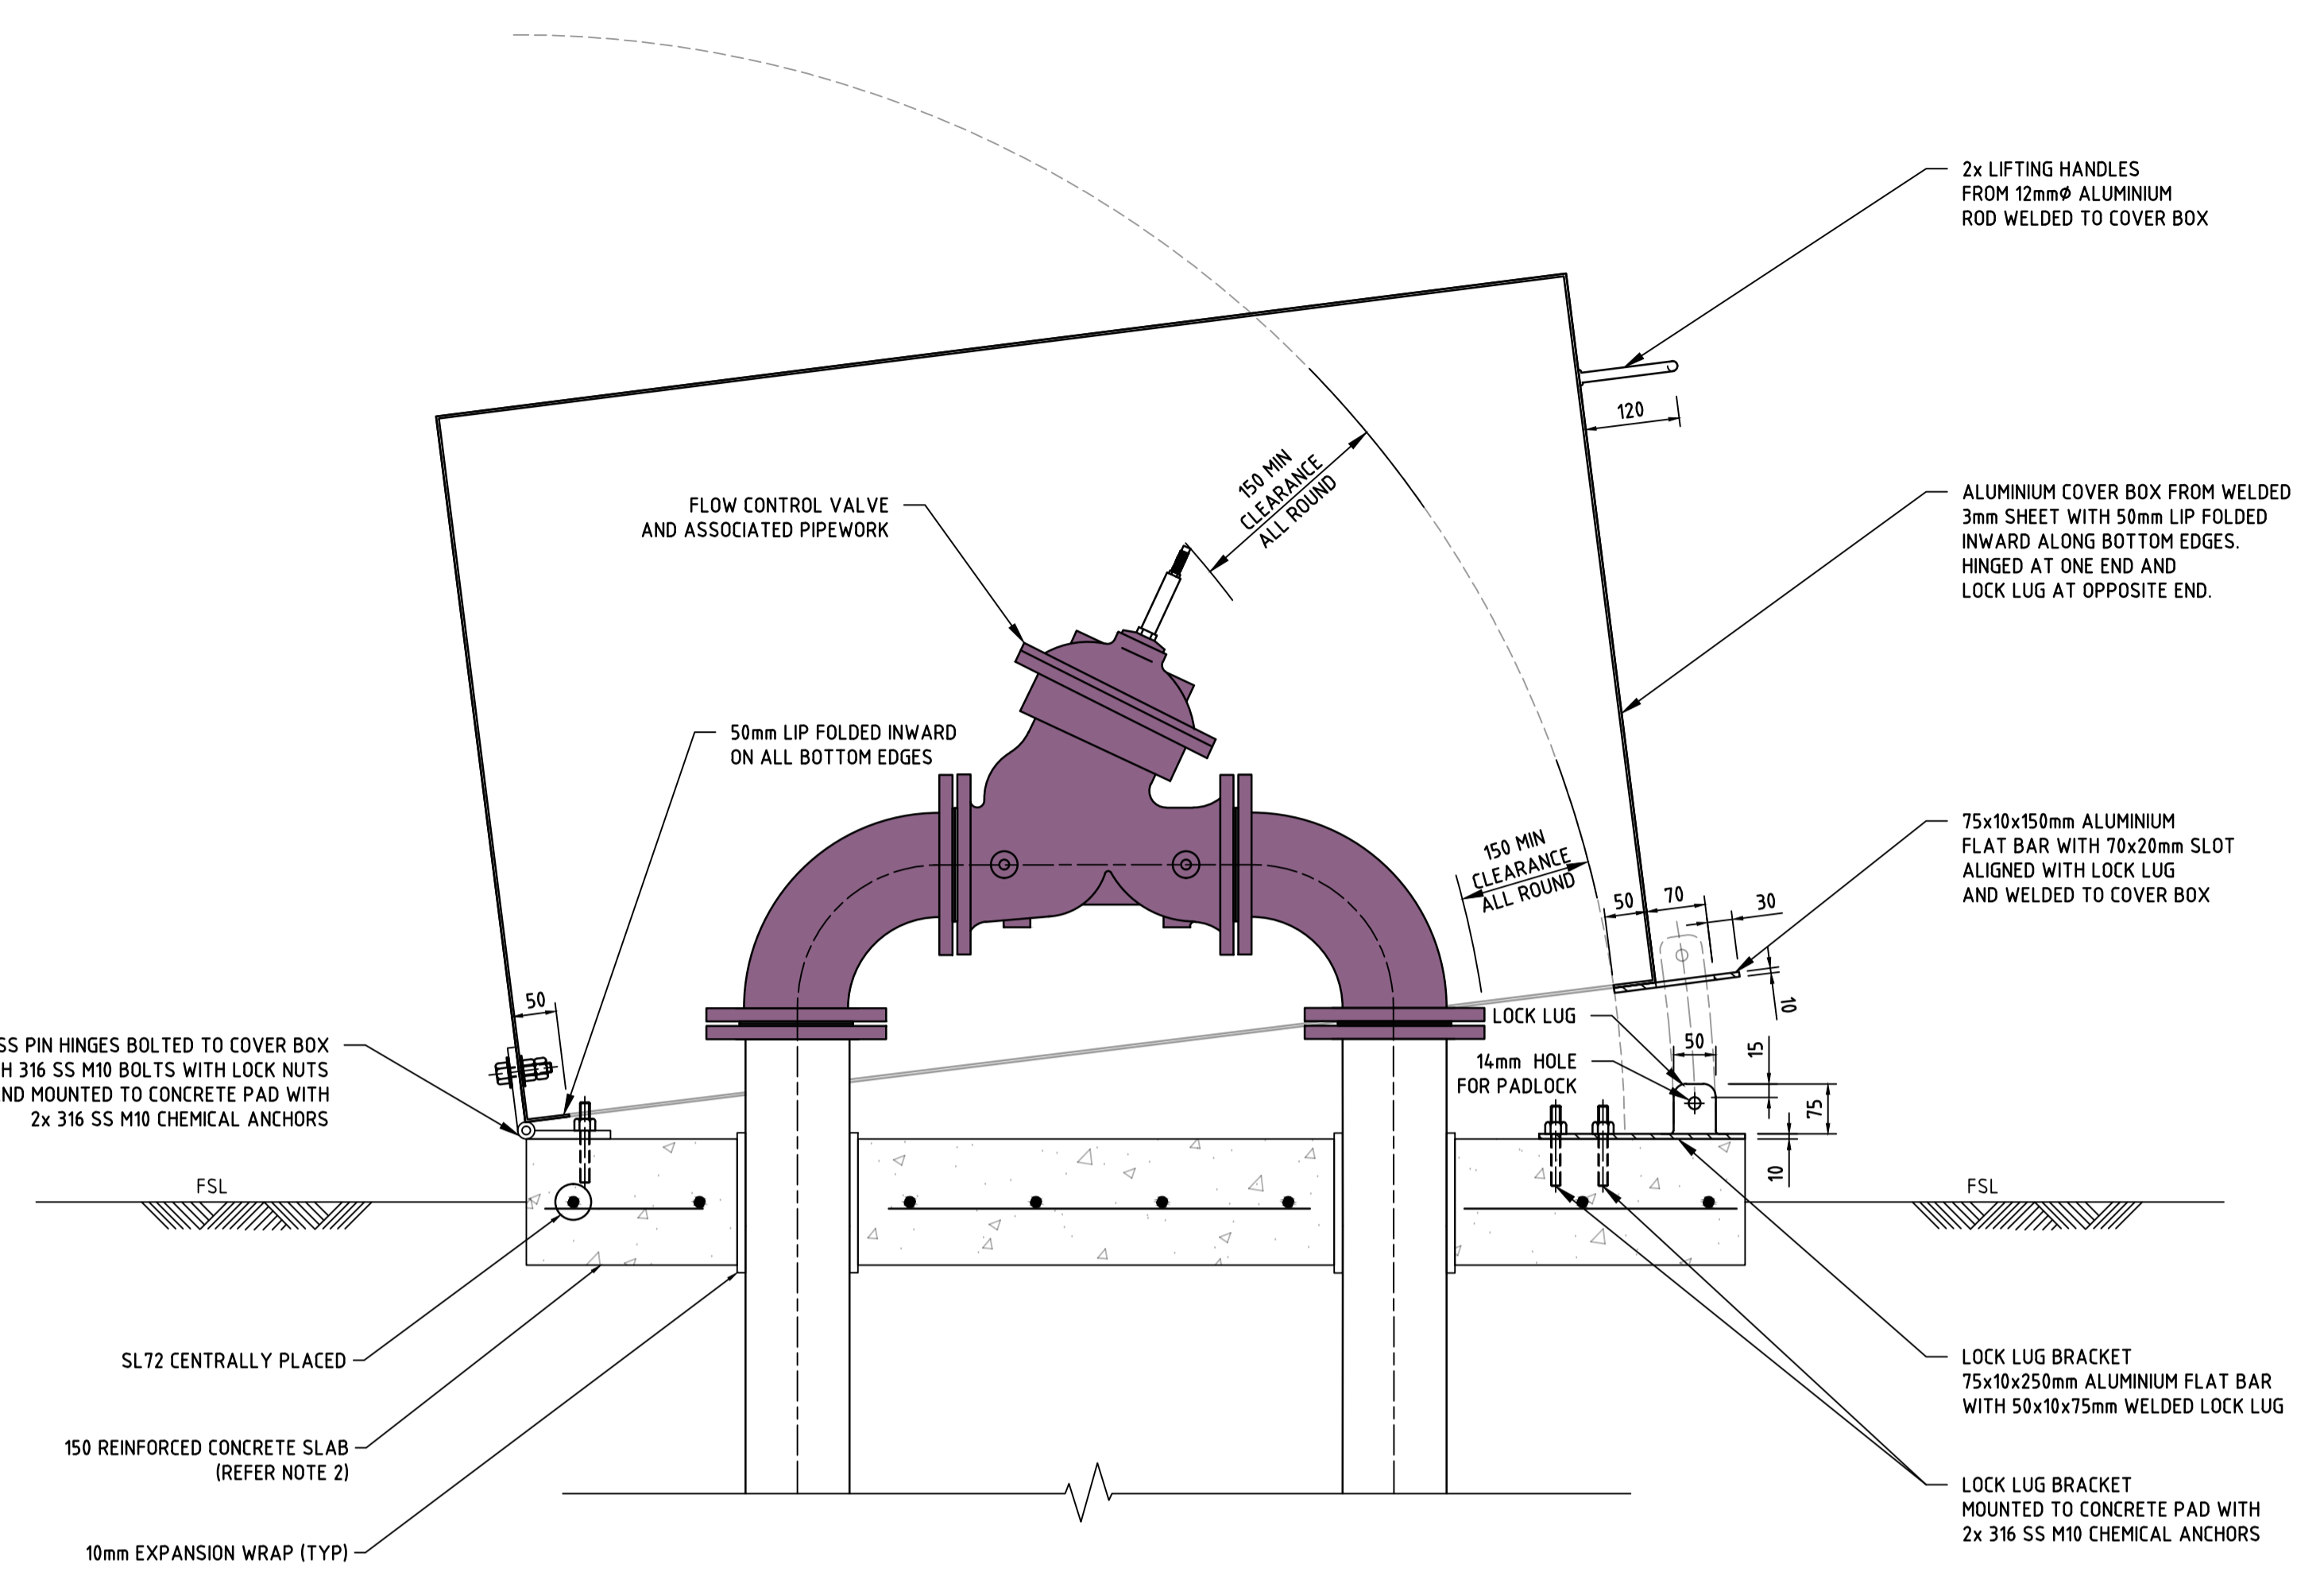

DETAIL 3 - HINGED ALUMINIUM COVER BOX WITH LOCKING LUG DETAILED ELEVATION

NOTES:

1. ALUMINIUM COVER BOX IS TO HAVE A MINIMUM OF 150mm CLEARANCE IN ALL DIRECTIONS FROM FLOW CONTROL VALVE WHILE BOTH CLOSED AND OPENING.
2. CONCRETE SLAB TO BE SIZED WITH CONSIDERATION TO REQUIREMENTS OF ALUMINIUM COVER BOX.
4. HOUSING FOR REMOTE LEVEL SENSOR UNIT IS TO BE CONSTRUCTED AND SLOTTED TO ALLOW FULL RANGE OF MOVEMENT OF BALL COCK VALVE MECHANISM.
3. NEOPRENE WASHERS AND PACKERS TO BE USED TO ELIMINATE CONTACT BETWEEN ALL ALUMINIUM AND STAINLESS STEEL FITTINGS, BOLTS, ETC.
4. ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE STATED.

PRELIMINARY ISSUE
NOT FOR CONSTRUCTION

				CONSULTANT DETAILS:		DESIGNED: R.D. DATE: 1-6-15 COMPANY: S.W.		TITLE: RECLAIMED WATER MANAGEMENT SCHEME	
						DRAWN: R.D. DATE: 1-7-15 COMPANY: S.W.		REMS 1B	
						CHECKED: D.T. DATE: 21-8-15 COMPANY: S.W.		SERVICE 80mm OR GREATER	
						APPROVED: D.B. DATE: COMPANY: S.W.		TYPICAL FLOW CONTROL VALVE ARRANGEMENT	
				CONSULTANT REFERENCE No.		SIZE: A1 SCALE: N.T.S. INDEX No.		DRAWING No. 24066 SHEET 013 REV No. A	
A ISSUED FOR REVIEW R.D. 15-7-15									
REVISION DETAILS				DWN DATE					
No.	1	2	3	4	5	6	7	8	9