

Berry Wastewater Treatment Plant - Monitoring Summary


Licensee: Shoalhaven City Council, Shoalhaven Water, PO Box 42 Nowra 2541

Environment Protection License No. 1736

EPA ID No. 3


BOD

Frequency	Date Sample Obtained	Date Result Obtained	Unit Of Measurement	90 percentile limit*	100 percentile limit	Council Sample
Monthly	02-Jun-21	11-Jun-21	milligrams per litre	10	15	<2
Monthly	07-Jul-21	16-Jul-21	milligrams per litre	10	15	<2
Monthly	04-Aug-21	13-Aug-21	milligrams per litre	10	15	<2
Monthly	01-Sep-21	09-Sep-21	milligrams per litre	10	15	<2
Monthly	06-Oct-21	15-Oct-21	milligrams per litre	10	15	<2
Monthly	03-Nov-21	11-Nov-21	milligrams per litre	10	15	<2
Monthly	08-Dec-21	16-Dec-21	milligrams per litre	10	15	2
Monthly	12-Jan-22	20-Jan-22	milligrams per litre	10	15	<2
Monthly	09-Feb-22	18-Feb-22	milligrams per litre	10	15	5
Monthly	16-Mar-22	24-Mar-22	milligrams per litre	10	15	<2
Monthly	05-Apr-22	13-Apr-22	milligrams per litre	10	15	<2
Monthly	03-May-22	11-May-22	milligrams per litre	10	15	<2

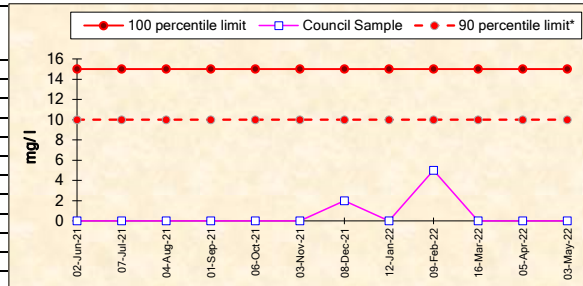


TOTAL NITROGEN

Frequency	Date Sample Obtained	Date Result Obtained	Unit Of Measurement	90 percentile limit*	100 percentile limit	Council Sample
Monthly	02-Jun-21	11-Jun-21	milligrams per litre	10	15	2.9
Monthly	07-Jul-21	16-Jul-21	milligrams per litre	10	15	4.5
Monthly	04-Aug-21	13-Aug-21	milligrams per litre	10	15	5.2
Monthly	01-Sep-21	09-Sep-21	milligrams per litre	10	15	6.6
Monthly	06-Oct-21	15-Oct-21	milligrams per litre	10	15	7.2
Monthly	03-Nov-21	11-Nov-21	milligrams per litre	10	15	5.5
Monthly	08-Dec-21	16-Dec-21	milligrams per litre	10	15	4.8
Monthly	12-Jan-22	20-Jan-22	milligrams per litre	10	15	6.2
Monthly	09-Feb-22	18-Feb-22	milligrams per litre	10	15	6.5
Monthly	16-Mar-22	24-Mar-22	milligrams per litre	10	15	6.6
Monthly	05-Apr-22	13-Apr-22	milligrams per litre	10	15	4.8
Monthly	03-May-22	11-May-22	milligrams per litre	10	15	5.0

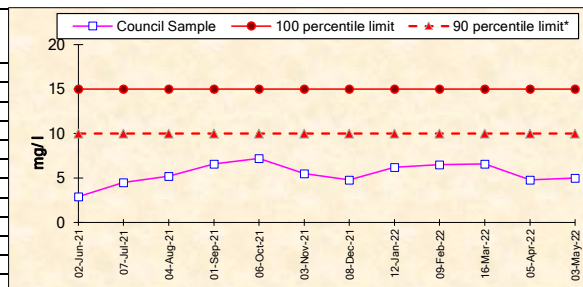


OIL AND GREASE

Frequency	Date Sample Obtained	Date Result Obtained	Unit Of Measurement	90 percentile limit*	100 percentile limit	Council Sample
Monthly	02-Jun-21	11-Jun-21	milligrams per litre	2	10	<1
Monthly	07-Jul-21	16-Jul-21	milligrams per litre	2	10	<1
Monthly	04-Aug-21	13-Aug-21	milligrams per litre	2	10	<1
Monthly	01-Sep-21	09-Sep-21	milligrams per litre	2	10	<1
Monthly	06-Oct-21	15-Oct-21	milligrams per litre	2	10	<1
Monthly	03-Nov-21	11-Nov-21	milligrams per litre	2	10	<1
Monthly	08-Dec-21	16-Dec-21	milligrams per litre	2	10	<1
Monthly	12-Jan-22	20-Jan-22	milligrams per litre	2	10	<1
Monthly	09-Feb-22	18-Feb-22	milligrams per litre	2	10	<1
Monthly	16-Mar-22	24-Mar-22	milligrams per litre	2	10	<1
Monthly	05-Apr-22	13-Apr-22	milligrams per litre	2	10	<2
Monthly	03-May-22	11-May-22	milligrams per litre	2	10	<1

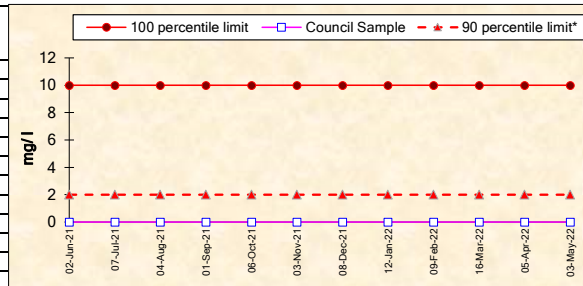


TOTAL PHOSPHORUS

Frequency	Date Sample Obtained	Date Result Obtained	Unit Of Measurement	90 percentile limit*	100 percentile limit	Council Sample
Monthly	02-Jun-21	11-Jun-21	milligrams per litre	0.5	1	0.18
Monthly	07-Jul-21	16-Jul-21	milligrams per litre	0.5	1	0.13
Monthly	04-Aug-21	13-Aug-21	milligrams per litre	0.5	1	0.20
Monthly	01-Sep-21	09-Sep-21	milligrams per litre	0.5	1	0.12
Monthly	06-Oct-21	15-Oct-21	milligrams per litre	0.5	1	0.08
Monthly	03-Nov-21	11-Nov-21	milligrams per litre	0.5	1	0.08
Monthly	08-Dec-21	16-Dec-21	milligrams per litre	0.5	1	0.11
Monthly	12-Jan-22	20-Jan-22	milligrams per litre	0.5	1	0.17
Monthly	09-Feb-22	18-Feb-22	milligrams per litre	0.5	1	0.43
Monthly	16-Mar-22	24-Mar-22	milligrams per litre	0.5	1	0.03
Monthly	05-Apr-22	13-Apr-22	milligrams per litre	0.5	1	0.21
Monthly	03-May-22	11-May-22	milligrams per litre	0.5	1	0.03

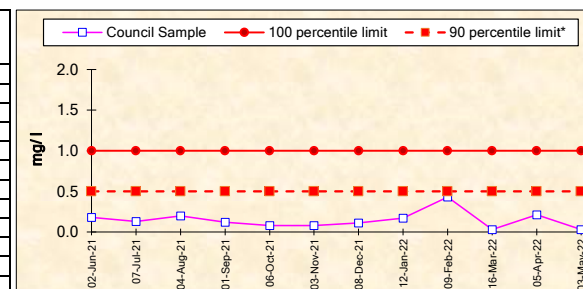


TOTAL SUSPENDED SOLIDS

Frequency	Date Sample Obtained	Date Result Obtained	Unit Of Measurement	90 percentile limit*	100 percentile limit	Council Sample
Monthly	02-Jun-21	11-Jun-21	milligrams per litre	10	15	3
Monthly	07-Jul-21	16-Jul-21	milligrams per litre	10	15	<1
Monthly	04-Aug-21	13-Aug-21	milligrams per litre	10	15	4
Monthly	01-Sep-21	09-Sep-21	milligrams per litre	10	15	2
Monthly	06-Oct-21	15-Oct-21	milligrams per litre	10	15	2
Monthly	03-Nov-21	11-Nov-21	milligrams per litre	10	15	1
Monthly	08-Dec-21	16-Dec-21	milligrams per litre	10	15	2
Monthly	12-Jan-22	20-Jan-22	milligrams per litre	10	15	3
Monthly	09-Feb-22	18-Feb-22	milligrams per litre	10	15	4
Monthly	16-Mar-22	24-Mar-22	milligrams per litre	10	15	2
Monthly	05-Apr-22	13-Apr-22	milligrams per litre	10	15	2
Monthly	03-May-22	11-May-22	milligrams per litre	10	15	2

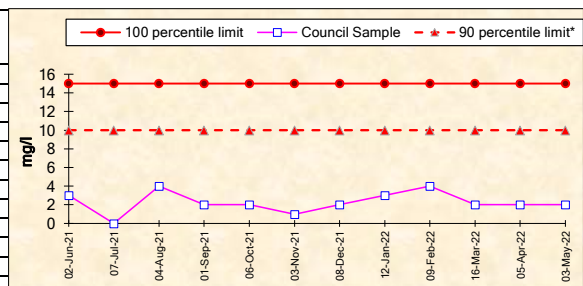


Faecal Coliforms

Frequency	Date Sample Obtained	Date Result Obtained	Unit Of Measurement	90 percentile limit*	100 percentile limit	Council Sample
Monthly	02-Jun-21	11-Jun-21	colony forming units per 100 millilitres	200	600	<1
Monthly	07-Jul-21	16-Jul-21	colony forming units per 100 millilitres	200	600	<1
Monthly	04-Aug-21	13-Aug-21	colony forming units per 100 millilitres	200	600	<1
Monthly	01-Sep-21	09-Sep-21	colony forming units per 100 millilitres	200	600	6
Monthly	06-Oct-21	15-Oct-21	colony forming units per 100 millilitres	200	600	6
Monthly	03-Nov-21	11-Nov-21	colony forming units per 100 millilitres	200	600	<1
Monthly	08-Dec-21	16-Dec-21	colony forming units per 100 millilitres	200	600	2
Monthly	12-Jan-22	20-Jan-22	colony forming units per 100 millilitres	200	600	<1
Monthly	09-Feb-22	18-Feb-22	colony forming units per 100 millilitres	200	600	<1
Monthly	16-Mar-22	24-Mar-22	colony forming units per 100 millilitres	200	600	6
Monthly	05-Apr-22	13-Apr-22	colony forming units per 100 millilitres	200	600	~2
Monthly	03-May-22	11-May-22	colony forming units per 100 millilitres	200	600	96

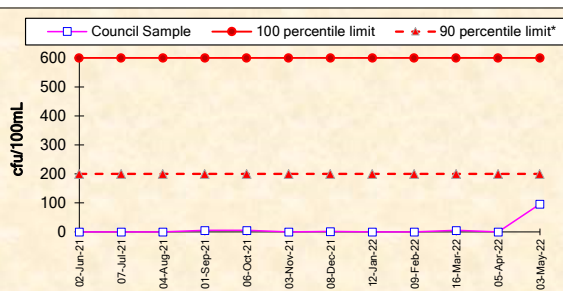


pH

Frequency	Date Sample Obtained	Date Result Obtained	Unit Of Measurement	100 percentile limit	Council Sample
Monthly	02-Jun-21	11-Jun-21	units	6.5-8.5	7.8
Monthly	07-Jul-21	16-Jul-21	units	6.5-8.5	7.4
Monthly	04-Aug-21	13-Aug-21	units	6.5-8.5	6.8
Monthly	01-Sep-21	09-Sep-21	units	6.5-8.5	7.2
Monthly	06-Oct-21	15-Oct-21	units	6.5-8.5	7.1
Monthly	03-Nov-21	11-Nov-21	units	6.5-8.5	7.4
Monthly	08-Dec-21	16-Dec-21	units	6.5-8.5	6.9
Monthly	12-Jan-22	20-Jan-22	units	6.5-8.5	7.9
Monthly	09-Feb-22	18-Feb-22	units	6.5-8.5	7.5
Monthly	16-Mar-22	24-Mar-22	units	6.5-8.5	7.1
Monthly	05-Apr-22	13-Apr-22	units	6.5-8.5	7.4
Monthly	03-May-22	11-May-22	units	6.5-8.5	6.7

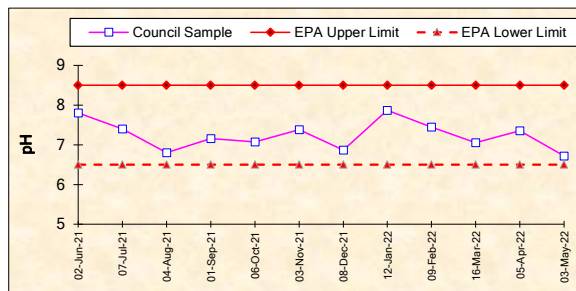

AMMONIA NITROGEN

Frequency	Date Sample Obtained	Date Result Obtained	Unit Of Measurement	90 percentile limit*	100 percentile limit	Council Sample
Monthly	02-Jun-21	11-Jun-21	milligrams per litre	2	5	0.07
Monthly	07-Jul-21	16-Jul-21	milligrams per litre	2	5	0.18
Monthly	04-Aug-21	13-Aug-21	milligrams per litre	2	5	0.24
Monthly	01-Sep-21	09-Sep-21	milligrams per litre	2	5	0.15
Monthly	06-Oct-21	15-Oct-21	milligrams per litre	2	5	0.11
Monthly	03-Nov-21	11-Nov-21	milligrams per litre	2	5	0.16
Monthly	08-Dec-21	16-Dec-21	milligrams per litre	2	5	0.03
Monthly	12-Jan-22	20-Jan-22	milligrams per litre	2	5	0.11
Monthly	09-Feb-22	18-Feb-22	milligrams per litre	2	5	0.08
Monthly	16-Mar-22	24-Mar-22	milligrams per litre	2	5	0.18
Monthly	05-Apr-22	13-Apr-22	milligrams per litre	2	5	0.13
Monthly	03-May-22	11-May-22	milligrams per litre	2	5	0.25

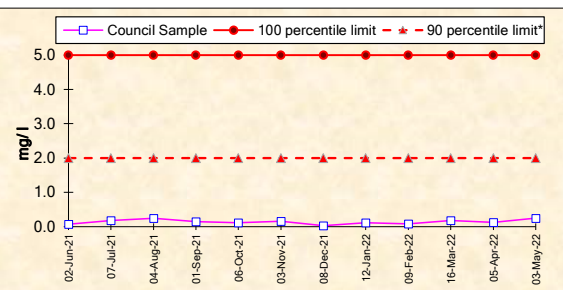

* Note: 90th percentile limit compliance calculated on an annual basis

non-compliance notes: