

Conjola Regional Sewerage Scheme - Monitoring Summary


Licensee: Shoalhaven City Council, Shoalhaven Water, PO Box 42 Nowra 2541

Environment Protection License No. 12357

EPA ID No. 3 (Bendalong WwTP)


BOD

Frequency	Date Sample Obtained	Date Result Obtained	Unit of Measurement	90 Percentile Limit*	100 Percentile Limit	Council Sample
Monthly	01-Jun-22	09-Jun-22	milligrams per litre (mg/L)	10	15	<2
Monthly	13-Jul-22	21-Sep-22	milligrams per litre (mg/L)	10	15	<2
Monthly	03-Aug-22	11-Aug-22	milligrams per litre (mg/L)	10	15	<2
Monthly	07-Sep-22	15-Sep-22	milligrams per litre (mg/L)	10	15	<2
Monthly	05-Oct-22	13-Oct-22	milligrams per litre (mg/L)	10	15	<2
Monthly	02-Nov-22	11-Nov-22	milligrams per litre (mg/L)	10	15	<2
Monthly	07-Dec-22	15-Dec-22	milligrams per litre (mg/L)	10	15	<2
Monthly	11-Jan-23	19-Jan-23	milligrams per litre (mg/L)	10	15	<2
Monthly	01-Feb-23	09-Feb-23	milligrams per litre (mg/L)	10	15	<2
Monthly	01-Mar-23	09-Mar-23	milligrams per litre (mg/L)	10	15	<2
Monthly	05-Apr-23	17-Apr-23	milligrams per litre (mg/L)	10	15	<2
Monthly	10-May-23	16-May-23	milligrams per litre (mg/L)	10	15	<2

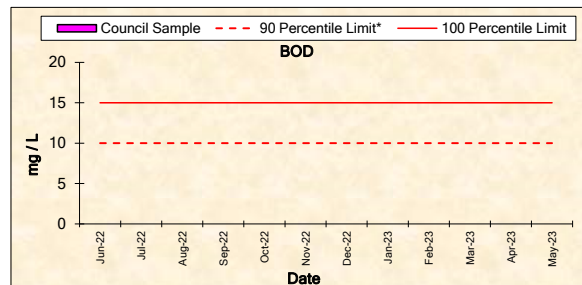


TOTAL NITROGEN

Frequency	Date Sample Obtained	Date Result Obtained	Unit of Measurement	90 Percentile Limit*	100 Percentile Limit	Council Sample
Monthly	01-Jun-22	09-Jun-22	milligrams per litre (mg/L)	10	15	3.4
Monthly	13-Jul-22	21-Sep-22	milligrams per litre (mg/L)	10	15	1.6
Monthly	03-Aug-22	11-Aug-22	milligrams per litre (mg/L)	10	15	2.2
Monthly	07-Sep-22	15-Sep-22	milligrams per litre (mg/L)	10	15	2.0
Monthly	05-Oct-22	13-Oct-22	milligrams per litre (mg/L)	10	15	15.8
Monthly	02-Nov-22	11-Nov-22	milligrams per litre (mg/L)	10	15	4.9
Monthly	07-Dec-22	15-Dec-22	milligrams per litre (mg/L)	10	15	2.9
Monthly	11-Jan-23	19-Jan-23	milligrams per litre (mg/L)	10	15	3.1
Monthly	01-Feb-23	09-Feb-23	milligrams per litre (mg/L)	10	15	2.3
Monthly	01-Mar-23	09-Mar-23	milligrams per litre (mg/L)	10	15	2.8
Monthly	05-Apr-23	17-Apr-23	milligrams per litre (mg/L)	10	15	2.7
Monthly	10-May-23	16-May-23	milligrams per litre (mg/L)	10	15	2.9

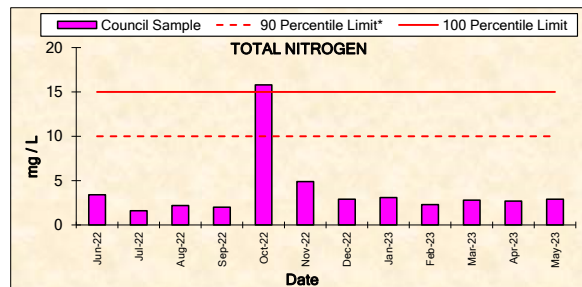


OIL AND GREASE

Frequency	Date Sample Obtained	Date Result Obtained	Unit of Measurement	90 Percentile Limit*	100 Percentile Limit	Council Sample
Monthly	01-Jun-22	09-Jun-22	milligrams per litre (mg/L)	2	10	<1
Monthly	13-Jul-22	21-Sep-22	milligrams per litre (mg/L)	2	10	<1
Monthly	03-Aug-22	11-Aug-22	milligrams per litre (mg/L)	2	10	<1
Monthly	07-Sep-22	15-Sep-22	milligrams per litre (mg/L)	2	10	<1
Monthly	05-Oct-22	13-Oct-22	milligrams per litre (mg/L)	2	10	<1
Monthly	02-Nov-22	11-Nov-22	milligrams per litre (mg/L)	2	10	<1
Monthly	07-Dec-22	15-Dec-22	milligrams per litre (mg/L)	2	10	<1
Monthly	11-Jan-23	19-Jan-23	milligrams per litre (mg/L)	2	10	<1
Monthly	01-Feb-23	09-Feb-23	milligrams per litre (mg/L)	2	10	<1
Monthly	01-Mar-23	09-Mar-23	milligrams per litre (mg/L)	2	10	<1
Monthly	05-Apr-23	17-Apr-23	milligrams per litre (mg/L)	2	10	<1
Monthly	10-May-23	16-May-23	milligrams per litre (mg/L)	2	10	<1

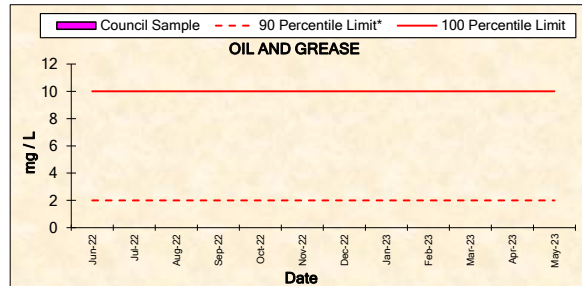


TOTAL PHOSPHORUS

Frequency	Date Sample Obtained	Date Result Obtained	Unit of Measurement	50 Percentile Limit*	100 Percentile Limit	Council Sample
Monthly	01-Jun-22	09-Jun-22	milligrams per litre (mg/L)	7	10	1.62
Monthly	13-Jul-22	21-Sep-22	milligrams per litre (mg/L)	7	10	0.44
Monthly	03-Aug-22	11-Aug-22	milligrams per litre (mg/L)	7	10	1.66
Monthly	07-Sep-22	15-Sep-22	milligrams per litre (mg/L)	7	10	1.08
Monthly	05-Oct-22	13-Oct-22	milligrams per litre (mg/L)	7	10	0.81
Monthly	02-Nov-22	11-Nov-22	milligrams per litre (mg/L)	7	10	0.40
Monthly	07-Dec-22	15-Dec-22	milligrams per litre (mg/L)	7	10	0.76
Monthly	11-Jan-23	19-Jan-23	milligrams per litre (mg/L)	7	10	3.47
Monthly	01-Feb-23	09-Feb-23	milligrams per litre (mg/L)	7	10	11.40
Monthly	01-Mar-23	09-Mar-23	milligrams per litre (mg/L)	7	10	5.88
Monthly	05-Apr-23	17-Apr-23	milligrams per litre (mg/L)	7	10	4.00
Monthly	10-May-23	16-May-23	milligrams per litre (mg/L)	7	10	2.87

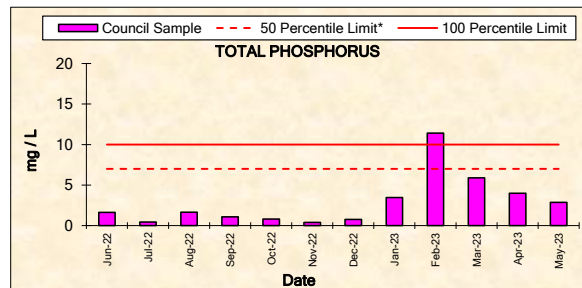


TOTAL SUSPENDED SOLIDS

Frequency	Date Sample Obtained	Date Result Obtained	Unit of Measurement	50 Percentile Limit*	100 Percentile Limit	Council Sample
Monthly	01-Jun-22	09-Jun-22	milligrams per litre (mg/L)	5	20	1
Monthly	13-Jul-22	21-Sep-22	milligrams per litre (mg/L)	5	20	<1
Monthly	03-Aug-22	11-Aug-22	milligrams per litre (mg/L)	5	20	<1
Monthly	07-Sep-22	15-Sep-22	milligrams per litre (mg/L)	5	20	1
Monthly	05-Oct-22	13-Oct-22	milligrams per litre (mg/L)	5	20	<1
Monthly	02-Nov-22	11-Nov-22	milligrams per litre (mg/L)	5	20	<1
Monthly	07-Dec-22	15-Dec-22	milligrams per litre (mg/L)	5	20	<1
Monthly	11-Jan-23	19-Jan-23	milligrams per litre (mg/L)	5	20	<1
Monthly	01-Feb-23	09-Feb-23	milligrams per litre (mg/L)	5	20	<1
Monthly	01-Mar-23	09-Mar-23	milligrams per litre (mg/L)	5	20	1
Monthly	05-Apr-23	17-Apr-23	milligrams per litre (mg/L)	5	20	1
Monthly	10-May-23	16-May-23	milligrams per litre (mg/L)	5	20	<1

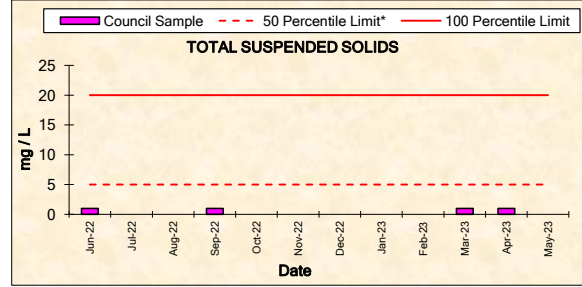


FAECAL COLIFORMS

Frequency	Date Sample Obtained	Date Result Obtained	Unit of Measurement	90 Percentile Limit*	100 Percentile Limit	Council Sample
Monthly	01-Jun-22	09-Jun-22	colony forming units per 100 millilitres (cfu/100mL)	200	600	<1
Monthly	13-Jul-22	21-Sep-22	colony forming units per 100 millilitres (cfu/100mL)	200	600	<1
Monthly	03-Aug-22	11-Aug-22	colony forming units per 100 millilitres (cfu/100mL)	200	600	<1
Monthly	07-Sep-22	15-Sep-22	colony forming units per 100 millilitres (cfu/100mL)	200	600	<1
Monthly	05-Oct-22	13-Oct-22	colony forming units per 100 millilitres (cfu/100mL)	200	600	~1
Monthly	02-Nov-22	11-Nov-22	colony forming units per 100 millilitres (cfu/100mL)	200	600	~1
Monthly	07-Dec-22	15-Dec-22	colony forming units per 100 millilitres (cfu/100mL)	200	600	<1
Monthly	11-Jan-23	19-Jan-23	colony forming units per 100 millilitres (cfu/100mL)	200	600	~1
Monthly	01-Feb-23	09-Feb-23	colony forming units per 100 millilitres (cfu/100mL)	200	600	<1
Monthly	01-Mar-23	09-Mar-23	colony forming units per 100 millilitres (cfu/100mL)	200	600	<1
Monthly	05-Apr-23	17-Apr-23	colony forming units per 100 millilitres (cfu/100mL)	200	600	<1
Monthly	10-May-23	16-May-23	colony forming units per 100 millilitres (cfu/100mL)	200	600	<1

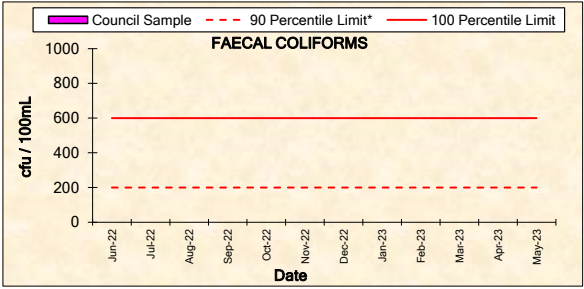


pH

Frequency	Date Sample Obtained	Date Result Obtained	Unit of Measurement		100 Percentile Limit	Council Sample
Monthly	01-Jun-22	09-Jun-22	pH		6.5-8.5	7.7
Monthly	13-Jul-22	21-Sep-22	pH		6.5-8.5	7.5
Monthly	03-Aug-22	11-Aug-22	pH		6.5-8.5	7.4
Monthly	07-Sep-22	15-Sep-22	pH		6.5-8.5	6.9
Monthly	05-Oct-22	13-Oct-22	pH		6.5-8.5	7.7
Monthly	02-Nov-22	11-Nov-22	pH		6.5-8.5	7.5
Monthly	07-Dec-22	15-Dec-22	pH		6.5-8.5	7.7
Monthly	11-Jan-23	19-Jan-23	pH		6.5-8.5	7.8
Monthly	01-Feb-23	09-Feb-23	pH		6.5-8.5	7.6
Monthly	01-Mar-23	09-Mar-23	pH		6.5-8.5	7.9
Monthly	05-Apr-23	17-Apr-23	pH		6.5-8.5	7.5
Monthly	10-May-23	16-May-23	pH		6.5-8.5	7.5

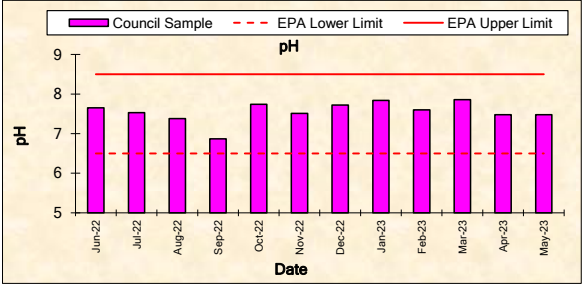


AMMONIA NITROGEN

Frequency	Date Sample Obtained	Date Result Obtained	Unit of Measurement	90 Percentile Limit*	100 Percentile Limit	Council Sample
Monthly	01-Jun-22	09-Jun-22	milligrams per litre (mg/L)	2	5	0.03
Monthly	13-Jul-22	21-Sep-22	milligrams per litre (mg/L)	2	5	0.08
Monthly	03-Aug-22	11-Aug-22	milligrams per litre (mg/L)	2	5	0.06
Monthly	07-Sep-22	15-Sep-22	milligrams per litre (mg/L)	2	5	0.10
Monthly	05-Oct-22	13-Oct-22	milligrams per litre (mg/L)	2	5	12.80
Monthly	02-Nov-22	11-Nov-22	milligrams per litre (mg/L)	2	5	1.01
Monthly	07-Dec-22	15-Dec-22	milligrams per litre (mg/L)	2	5	0.02
Monthly	11-Jan-23	19-Jan-23	milligrams per litre (mg/L)	2	5	0.06
Monthly	01-Feb-23	09-Feb-23	milligrams per litre (mg/L)	2	5	0.09
Monthly	01-Mar-23	09-Mar-23	milligrams per litre (mg/L)	2	5	0.05
Monthly	05-Apr-23	17-Apr-23	milligrams per litre (mg/L)	2	5	0.03
Monthly	10-May-23	16-May-23	milligrams per litre (mg/L)	2	5	0.02

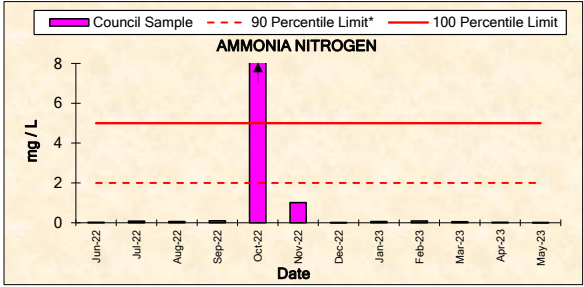

CHLORINE (Total Residual)

Frequency	Date Sample Obtained	Date Result Obtained	Unit of Measurement		100 Percentile Limit	Council Sample
Monthly	01-Jun-22	01-Jun-22	milligrams per litre (mg/L)	Monitoring	0.07	0.17
Monthly	13-Jul-22	13-Jul-22	milligrams per litre (mg/L)			0.06
Monthly	03-Aug-22	03-Aug-22	milligrams per litre (mg/L)			0.07
Monthly	07-Sep-22	07-Sep-22	milligrams per litre (mg/L)			0.27
Monthly	05-Oct-22	05-Oct-22	milligrams per litre (mg/L)			0.21
Monthly	02-Nov-22	02-Nov-22	milligrams per litre (mg/L)			0.31
Monthly	07-Dec-22	07-Dec-22	milligrams per litre (mg/L)			0.07
Monthly	11-Jan-23	11-Jan-23	milligrams per litre (mg/L)			0.09
Monthly	01-Feb-23	01-Feb-23	milligrams per litre (mg/L)			0.09
Monthly	01-Mar-23	09-Mar-23	milligrams per litre (mg/L)			0.15
Monthly	05-Apr-23	05-Apr-23	milligrams per litre (mg/L)			0.09
Monthly	29-May-23	29-May-23	milligrams per litre (mg/L)			0.03

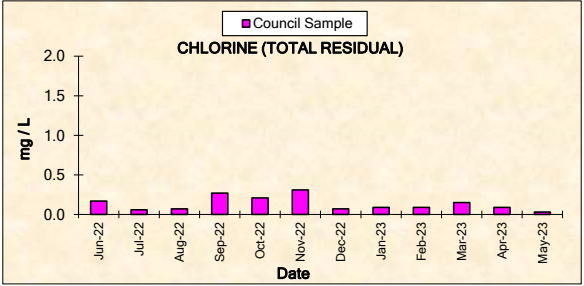

* Note: 50th & 90th percentile limit compliance calculated on an annual basis

non-compliance notes:

Conjola Regional Sewerage Scheme - Monitoring Summary


Licensee: Shoalhaven City Council, Shoalhaven Water, PO Box 42 Nowra 2541

Environment Protection License No. 12357

EPA ID No. 7 (Conjola WwTP)


BOD

Frequency	Date Sample Obtained	Date Result Obtained	Unit of Measurement	90 Percentile Limit*	100 Percentile Limit	Council Sample
Monthly	01-Jun-22	09-Jun-22	milligrams per litre (mg/L)	10	15	<2
Monthly	13-Jul-22	21-Jul-22	milligrams per litre (mg/L)	10	15	<2
Monthly	03-Aug-22	11-Aug-22	milligrams per litre (mg/L)	10	15	<2
Monthly	07-Sep-22	15-Sep-22	milligrams per litre (mg/L)	10	15	2
Monthly	12-Oct-22	20-Oct-22	milligrams per litre (mg/L)	10	15	<2
Monthly	02-Nov-22	11-Nov-22	milligrams per litre (mg/L)	10	15	<2
Monthly	07-Dec-22	15-Dec-22	milligrams per litre (mg/L)	10	15	<2
Monthly	11-Jan-23	19-Jan-23	milligrams per litre (mg/L)	10	15	<2
Monthly	01-Feb-23	09-Feb-23	milligrams per litre (mg/L)	10	15	<2
Monthly	01-Mar-23	09-Mar-23	milligrams per litre (mg/L)	10	15	<2
Monthly	05-Apr-23	17-Apr-23	milligrams per litre (mg/L)	10	15	<2
Monthly	17-May-23	25-May-23	milligrams per litre (mg/L)	10	15	<2

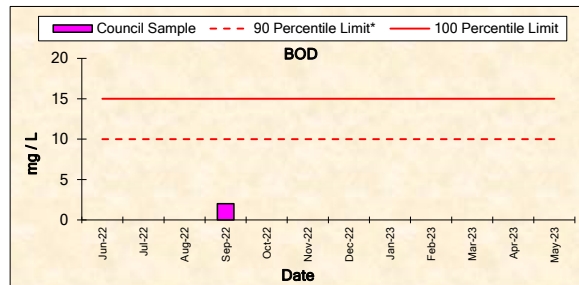


TOTAL NITROGEN

Frequency	Date Sample Obtained	Date Result Obtained	Unit of Measurement	90 Percentile Limit*	100 Percentile Limit	Council Sample
Monthly	01-Jun-22	09-Jun-22	milligrams per litre (mg/L)	10	15	5.7
Monthly	13-Jul-22	21-Jul-22	milligrams per litre (mg/L)	10	15	3.9
Monthly	03-Aug-22	11-Aug-22	milligrams per litre (mg/L)	10	15	4.2
Monthly	07-Sep-22	15-Sep-22	milligrams per litre (mg/L)	10	15	3.5
Monthly	12-Oct-22	20-Oct-22	milligrams per litre (mg/L)	10	15	2.4
Monthly	02-Nov-22	11-Nov-22	milligrams per litre (mg/L)	10	15	2.6
Monthly	07-Dec-22	15-Dec-22	milligrams per litre (mg/L)	10	15	5.2
Monthly	11-Jan-23	19-Jan-23	milligrams per litre (mg/L)	10	15	9.3
Monthly	01-Feb-23	09-Feb-23	milligrams per litre (mg/L)	10	15	4.6
Monthly	01-Mar-23	09-Mar-23	milligrams per litre (mg/L)	10	15	4.0
Monthly	05-Apr-23	17-Apr-23	milligrams per litre (mg/L)	10	15	2.9
Monthly	17-May-23	25-May-23	milligrams per litre (mg/L)	10	15	6.2

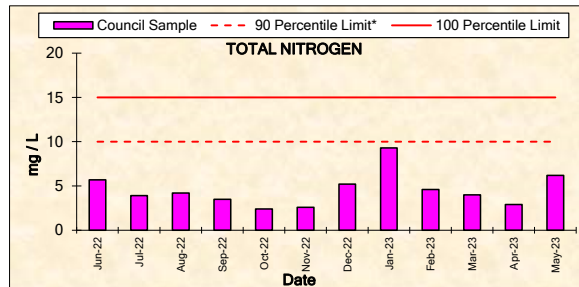


OIL AND GREASE

Frequency	Date Sample Obtained	Date Result Obtained	Unit of Measurement	90 Percentile Limit*	100 Percentile Limit	Council Sample
Monthly	01-Jun-22	09-Jun-22	milligrams per litre (mg/L)	2	10	<1
Monthly	13-Jul-22	21-Jul-22	milligrams per litre (mg/L)	2	10	<1
Monthly	03-Aug-22	11-Aug-22	milligrams per litre (mg/L)	2	10	<1
Monthly	07-Sep-22	15-Sep-22	milligrams per litre (mg/L)	2	10	<1
Monthly	12-Oct-22	20-Oct-22	milligrams per litre (mg/L)	2	10	<1
Monthly	02-Nov-22	11-Nov-22	milligrams per litre (mg/L)	2	10	<1
Monthly	07-Dec-22	15-Dec-22	milligrams per litre (mg/L)	2	10	<1
Monthly	11-Jan-23	19-Jan-23	milligrams per litre (mg/L)	2	10	<1
Monthly	01-Feb-23	09-Feb-23	milligrams per litre (mg/L)	2	10	<1
Monthly	01-Mar-23	09-Mar-23	milligrams per litre (mg/L)	2	10	<1
Monthly	05-Apr-23	17-Apr-23	milligrams per litre (mg/L)	2	10	<1
Monthly	17-May-23	25-May-23	milligrams per litre (mg/L)	2	10	<1

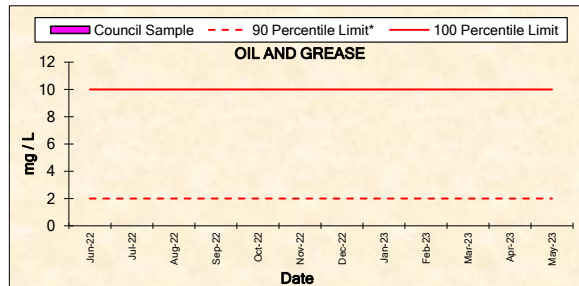


TOTAL PHOSPHORUS

Frequency	Date Sample Obtained	Date Result Obtained	Unit of Measurement	50 Percentile Limit*	100 Percentile Limit	Council Sample
Monthly	01-Jun-22	09-Jun-22	milligrams per litre (mg/L)	7	10	3.0
Monthly	13-Jul-22	21-Jul-22	milligrams per litre (mg/L)	7	10	1.9
Monthly	03-Aug-22	11-Aug-22	milligrams per litre (mg/L)	7	10	4.2
Monthly	07-Sep-22	15-Sep-22	milligrams per litre (mg/L)	7	10	2.0
Monthly	12-Oct-22	20-Oct-22	milligrams per litre (mg/L)	7	10	0.9
Monthly	02-Nov-22	11-Nov-22	milligrams per litre (mg/L)	7	10	1.3
Monthly	07-Dec-22	15-Dec-22	milligrams per litre (mg/L)	7	10	4.8
Monthly	11-Jan-23	19-Jan-23	milligrams per litre (mg/L)	7	10	2.9
Monthly	01-Feb-23	09-Feb-23	milligrams per litre (mg/L)	7	10	2.4
Monthly	01-Mar-23	09-Mar-23	milligrams per litre (mg/L)	7	10	2.5
Monthly	05-Apr-23	17-Apr-23	milligrams per litre (mg/L)	7	10	1.8
Monthly	17-May-23	25-May-23	milligrams per litre (mg/L)	7	10	2.8

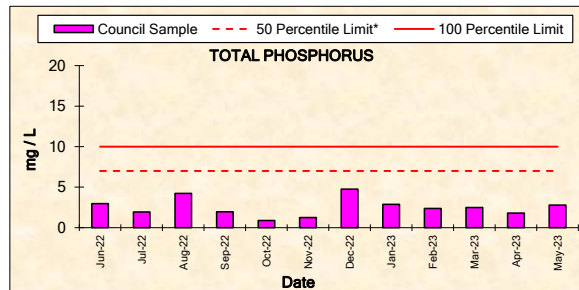


TOTAL SUSPENDED SOLIDS

Frequency	Date Sample Obtained	Date Result Obtained	Unit of Measurement	50 Percentile Limit*	100 Percentile Limit	Council Sample
Monthly	01-Jun-22	09-Jun-22	milligrams per litre (mg/L)	5	20	<1
Monthly	13-Jul-22	21-Jul-22	milligrams per litre (mg/L)	5	20	<1
Monthly	03-Aug-22	11-Aug-22	milligrams per litre (mg/L)	5	20	1
Monthly	07-Sep-22	15-Sep-22	milligrams per litre (mg/L)	5	20	<1
Monthly	12-Oct-22	20-Oct-22	milligrams per litre (mg/L)	5	20	<1
Monthly	02-Nov-22	11-Nov-22	milligrams per litre (mg/L)	5	20	<1
Monthly	07-Dec-22	15-Dec-22	milligrams per litre (mg/L)	5	20	7
Monthly	11-Jan-23	19-Jan-23	milligrams per litre (mg/L)	5	20	1
Monthly	01-Feb-23	09-Feb-23	milligrams per litre (mg/L)	5	20	<1
Monthly	01-Mar-23	09-Mar-23	milligrams per litre (mg/L)	5	20	<1
Monthly	05-Apr-23	17-Apr-23	milligrams per litre (mg/L)	5	20	<1
Monthly	17-May-23	25-May-23	milligrams per litre (mg/L)	5	20	1

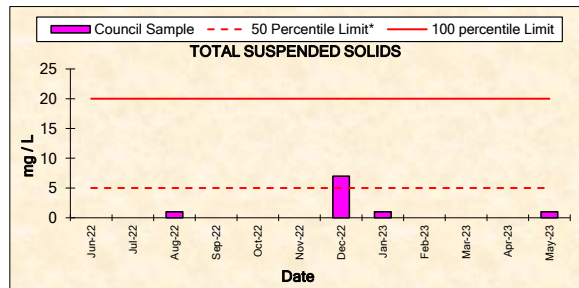


FAECAL COLIFORMS

Frequency	Date Sample Obtained	Date Result Obtained	Unit of Measurement	90 Percentile Limit*	100 Percentile Limit	Council Sample
Monthly	01-Jun-22	09-Jun-22	colony forming units per 100 millilitres (cfu/100mL)	200	600	<1
Monthly	13-Jul-22	21-Jul-22	colony forming units per 100 millilitres (cfu/100mL)	200	600	~1
Monthly	03-Aug-22	11-Aug-22	colony forming units per 100 millilitres (cfu/100mL)	200	600	<1
Monthly	07-Sep-22	15-Sep-22	colony forming units per 100 millilitres (cfu/100mL)	200	600	<1
Monthly	12-Oct-22	20-Oct-22	colony forming units per 100 millilitres (cfu/100mL)	200	600	<1
Monthly	02-Nov-22	11-Nov-22	colony forming units per 100 millilitres (cfu/100mL)	200	600	<1
Monthly	07-Dec-22	15-Dec-22	colony forming units per 100 millilitres (cfu/100mL)	200	600	<1
Monthly	11-Jan-23	19-Jan-23	colony forming units per 100 millilitres (cfu/100mL)	200	600	<1
Monthly	01-Feb-23	09-Feb-23	colony forming units per 100 millilitres (cfu/100mL)	200	600	<1
Monthly	01-Mar-23	09-Mar-23	colony forming units per 100 millilitres (cfu/100mL)	200	600	~9
Monthly	05-Apr-23	17-Apr-23	colony forming units per 100 millilitres (cfu/100mL)	200	600	36
Monthly	17-May-23	25-May-23	colony forming units per 100 millilitres (cfu/100mL)	200	600	<1

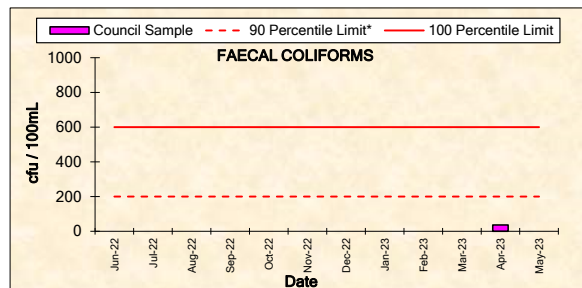


pH

Frequency	Date Sample Obtained	Date Result Obtained	Unit of Measurement	90 Percentile Limit*	100 Percentile Limit	Council Sample
Monthly	01-Jun-22	09-Jun-22	pH		6.5-8.5	7.6
Monthly	13-Jul-22	21-Jul-22	pH		6.5-8.5	7.4
Monthly	03-Aug-22	11-Aug-22	pH		6.5-8.5	7.5
Monthly	07-Sep-22	15-Sep-22	pH		6.5-8.5	7.3
Monthly	12-Oct-22	20-Oct-22	pH		6.5-8.5	7.6
Monthly	02-Nov-22	11-Nov-22	pH		6.5-8.5	7.6
Monthly	07-Dec-22	15-Dec-22	pH		6.5-8.5	7.6
Monthly	11-Jan-23	19-Jan-23	pH		6.5-8.5	7.6
Monthly	01-Feb-23	09-Feb-23	pH		6.5-8.5	7.7
Monthly	01-Mar-23	09-Mar-23	pH		6.5-8.5	7.8
Monthly	05-Apr-23	17-Apr-23	pH		6.5-8.5	7.2
Monthly	17-May-23	25-May-23	pH		6.5-8.5	7.2

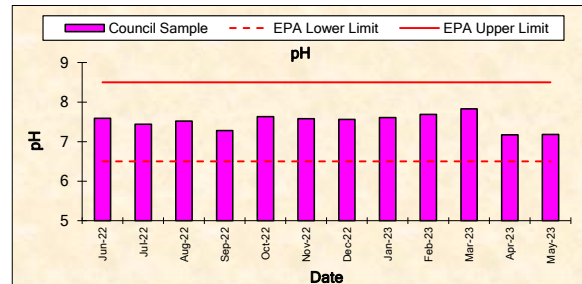


AMMONIA NITROGEN

Frequency	Date Sample Obtained	Date Result Obtained	Unit of Measurement	90 Percentile Limit*	100 Percentile Limit	Council Sample
Monthly	01-Jun-22	09-Jun-22	milligrams per litre (mg/L)	2	5	0.07
Monthly	13-Jul-22	21-Jul-22	milligrams per litre (mg/L)	2	5	0.05
Monthly	03-Aug-22	11-Aug-22	milligrams per litre (mg/L)	2	5	0.03
Monthly	07-Sep-22	15-Sep-22	milligrams per litre (mg/L)	2	5	0.04
Monthly	12-Oct-22	20-Oct-22	milligrams per litre (mg/L)	2	5	0.03
Monthly	02-Nov-22	11-Nov-22	milligrams per litre (mg/L)	2	5	0.07
Monthly	07-Dec-22	15-Dec-22	milligrams per litre (mg/L)	2	5	0.06
Monthly	11-Jan-23	19-Jan-23	milligrams per litre (mg/L)	2	5	0.94
Monthly	01-Feb-23	09-Feb-23	milligrams per litre (mg/L)	2	5	0.11
Monthly	01-Mar-23	09-Mar-23	milligrams per litre (mg/L)	2	5	0.07
Monthly	05-Apr-23	17-Apr-23	milligrams per litre (mg/L)	2	5	0.04
Monthly	17-May-23	25-May-23	milligrams per litre (mg/L)	2	5	0.01

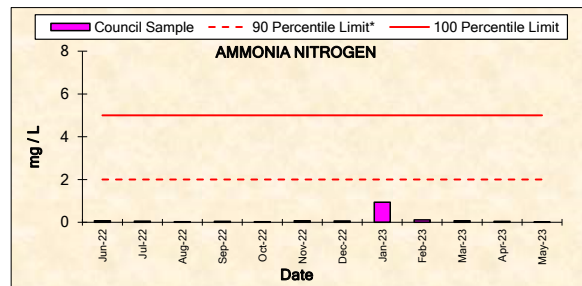

CHLORINE (Total Residual)

Frequency	Date Sample Obtained	Date Result Obtained	Unit of Measurement	90 Percentile Limit*	100 Percentile Limit	Council Sample
Monthly	01-Jun-22	01-Jun-22	milligrams per litre (mg/L)			0.21
Monthly	13-Jul-22	13-Jul-22	milligrams per litre (mg/L)			0.04
Monthly	03-Aug-22	03-Aug-22	milligrams per litre (mg/L)			0.06
Monthly	07-Sep-22	07-Sep-22	milligrams per litre (mg/L)			0.16
Monthly	12-Oct-22	12-Oct-22	milligrams per litre (mg/L)			0.08
Monthly	02-Nov-22	02-Nov-22	milligrams per litre (mg/L)			0.12
Monthly	07-Dec-22	07-Dec-22	milligrams per litre (mg/L)			0.18
Monthly	11-Jan-23	11-Jan-23	milligrams per litre (mg/L)			0.56
Monthly	01-Feb-23	01-Feb-23	milligrams per litre (mg/L)			0.08
Monthly	01-Mar-23	01-Mar-23	milligrams per litre (mg/L)			0.04
Monthly	05-Apr-23	05-Apr-23	milligrams per litre (mg/L)			0.21
Monthly	10-May-23	10-May-23	milligrams per litre (mg/L)			0.78

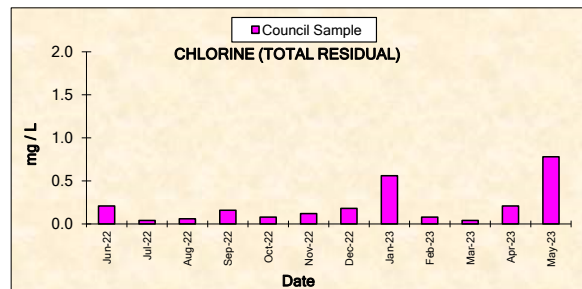

* Note: 50th & 90th percentile limit compliance calculated on an annual basis

non-compliance notes: