


Berry Wastewater Treatment Plant - Monitoring Summary
Licensee: Shoalhaven City Council, Shoalhaven Water, PO Box 42 Nowra 2541

Environment Protection License No. 1736
EPA ID No. 3


BOD

Frequency	Date Sample Obtained	Date Result Obtained	Unit of Measurement	90 Percentile Limit*	100 Percentile Limit	Council Sample
Monthly	07-Jun-23	15-Jun-23	milligrams per litre (mg/L)	10	15	<2
Monthly	05-Jul-23	12-Jul-23	milligrams per litre (mg/L)	10	15	<2
Monthly	02-Aug-23	10-Aug-23	milligrams per litre (mg/L)	10	15	2
Monthly	06-Sep-23	13-Sep-23	milligrams per litre (mg/L)	10	15	<2
Monthly	04-Oct-23	11-Oct-23	milligrams per litre (mg/L)	10	15	<2
Monthly	01-Nov-23	08-Nov-23	milligrams per litre (mg/L)	10	15	<2
Monthly	06-Dec-23	14-Dec-23	milligrams per litre (mg/L)	10	15	<2
Monthly	10-Jan-24	18-Jan-24	milligrams per litre (mg/L)	10	15	<2
Monthly	21-Feb-24	29-Feb-24	milligrams per litre (mg/L)	10	15	<2
Monthly	06-Mar-24	14-Mar-24	milligrams per litre (mg/L)	10	15	<2
Monthly	18-Apr-24	24-Apr-24	milligrams per litre (mg/L)	10	15	<2
Monthly	01-May-24	09-May-24	milligrams per litre (mg/L)	10	15	<2

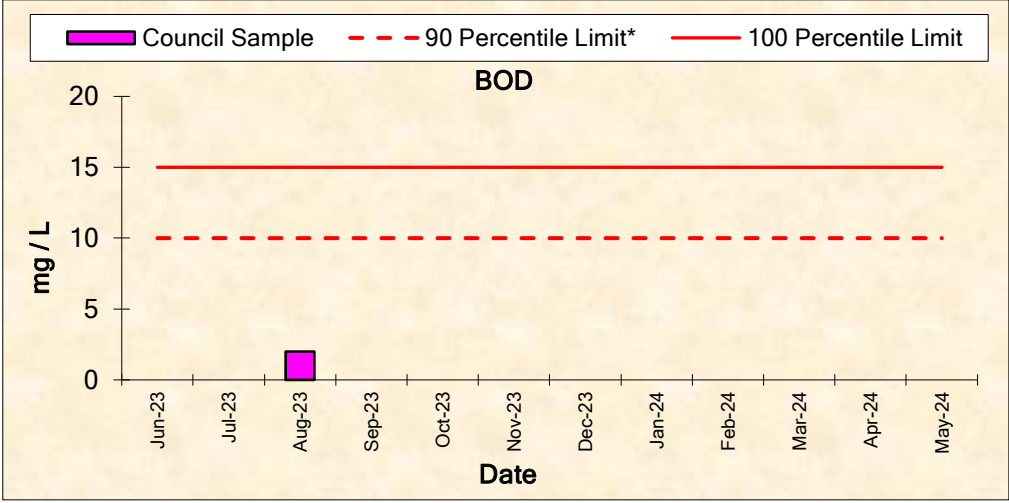


TOTAL NITROGEN

Frequency	Date Sample Obtained	Date Result Obtained	Unit of Measurement	90 Percentile Limit*	100 Percentile Limit	Council Sample
Monthly	07-Jun-23	15-Jun-23	milligrams per litre (mg/L)	10	15	4.8
Monthly	05-Jul-23	12-Jul-23	milligrams per litre (mg/L)	10	15	6.6
Monthly	02-Aug-23	10-Aug-23	milligrams per litre (mg/L)	10	15	4.4
Monthly	06-Sep-23	13-Sep-23	milligrams per litre (mg/L)	10	15	5.6
Monthly	04-Oct-23	11-Oct-23	milligrams per litre (mg/L)	10	15	6.1
Monthly	01-Nov-23	08-Nov-23	milligrams per litre (mg/L)	10	15	4.0
Monthly	06-Dec-23	14-Dec-23	milligrams per litre (mg/L)	10	15	6.1
Monthly	10-Jan-24	18-Jan-24	milligrams per litre (mg/L)	10	15	5.8
Monthly	21-Feb-24	29-Feb-24	milligrams per litre (mg/L)	10	15	5.0
Monthly	06-Mar-24	14-Mar-24	milligrams per litre (mg/L)	10	15	3.6
Monthly	18-Apr-24	24-Apr-24	milligrams per litre (mg/L)	10	15	4.6
Monthly	01-May-24	09-May-24	milligrams per litre (mg/L)	10	15	4.6

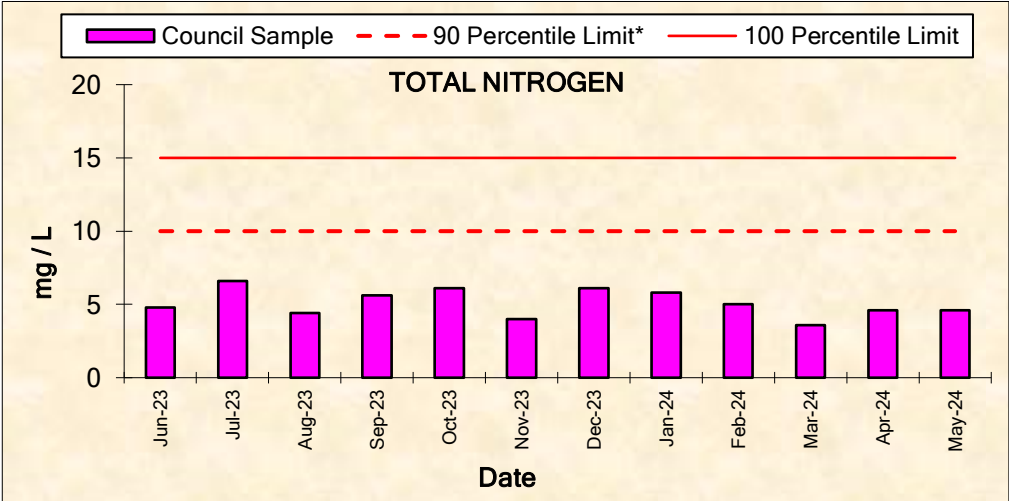


OIL AND GREASE

Frequency	Date Sample Obtained	Date Result Obtained	Unit of Measurement	90 Percentile Limit*	100 Percentile Limit	Council Sample
Monthly	07-Jun-23	15-Jun-23	milligrams per litre (mg/L)	2	10	<1
Monthly	05-Jul-23	12-Jul-23	milligrams per litre (mg/L)	2	10	<1
Monthly	02-Aug-23	10-Aug-23	milligrams per litre (mg/L)	2	10	<1
Monthly	06-Sep-23	13-Sep-23	milligrams per litre (mg/L)	2	10	<1
Monthly	04-Oct-23	11-Oct-23	milligrams per litre (mg/L)	2	10	<1
Monthly	01-Nov-23	08-Nov-23	milligrams per litre (mg/L)	2	10	<1
Monthly	06-Dec-23	14-Dec-23	milligrams per litre (mg/L)	2	10	<1
Monthly	10-Jan-24	18-Jan-24	milligrams per litre (mg/L)	2	10	<1
Monthly	21-Feb-24	29-Feb-24	milligrams per litre (mg/L)	2	10	<1
Monthly	06-Mar-24	14-Mar-24	milligrams per litre (mg/L)	2	10	<1
Monthly	18-Apr-24	24-Apr-24	milligrams per litre (mg/L)	2	10	<1
Monthly	01-May-24	09-May-24	milligrams per litre (mg/L)	2	10	<1

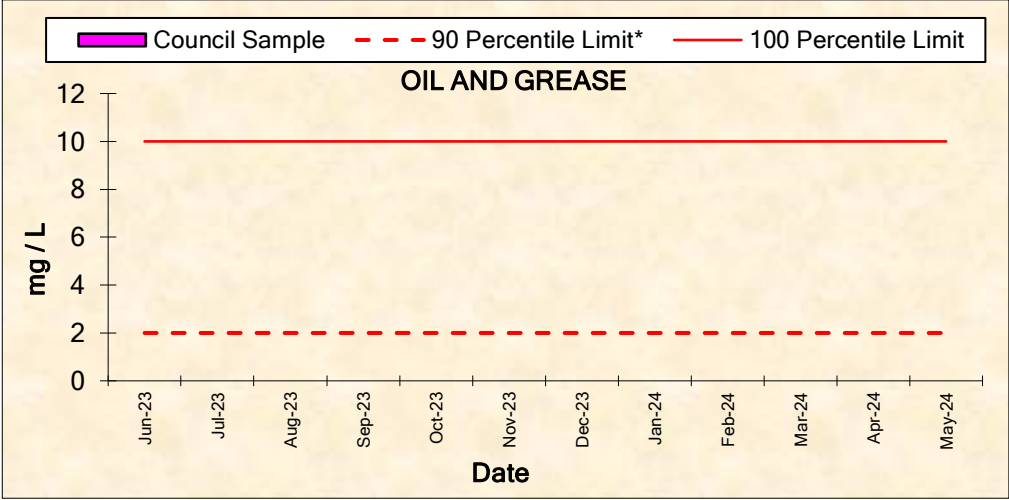


TOTAL PHOSPHORUS

Frequency	Date Sample Obtained	Date Result Obtained	Unit of Measurement	90 Percentile Limit*	100 Percentile Limit	Council Sample
Monthly	07-Jun-23	15-Jun-23	milligrams per litre (mg/L)	0.5	1	0.10
Monthly	05-Jul-23	12-Jul-23	milligrams per litre (mg/L)	0.5	1	0.26
Monthly	02-Aug-23	10-Aug-23	milligrams per litre (mg/L)	0.5	1	0.10
Monthly	06-Sep-23	13-Sep-23	milligrams per litre (mg/L)	0.5	1	0.31
Monthly	04-Oct-23	11-Oct-23	milligrams per litre (mg/L)	0.5	1	0.28
Monthly	01-Nov-23	08-Nov-23	milligrams per litre (mg/L)	0.5	1	0.27
Monthly	06-Dec-23	14-Dec-23	milligrams per litre (mg/L)	0.5	1	0.11
Monthly	10-Jan-24	18-Jan-24	milligrams per litre (mg/L)	0.5	1	0.08
Monthly	21-Feb-24	29-Feb-24	milligrams per litre (mg/L)	0.5	1	0.16
Monthly	06-Mar-24	14-Mar-24	milligrams per litre (mg/L)	0.5	1	0.16
Monthly	18-Apr-24	24-Apr-24	milligrams per litre (mg/L)	0.5	1	0.13
Monthly	01-May-24	09-May-24	milligrams per litre (mg/L)	0.5	1	0.11

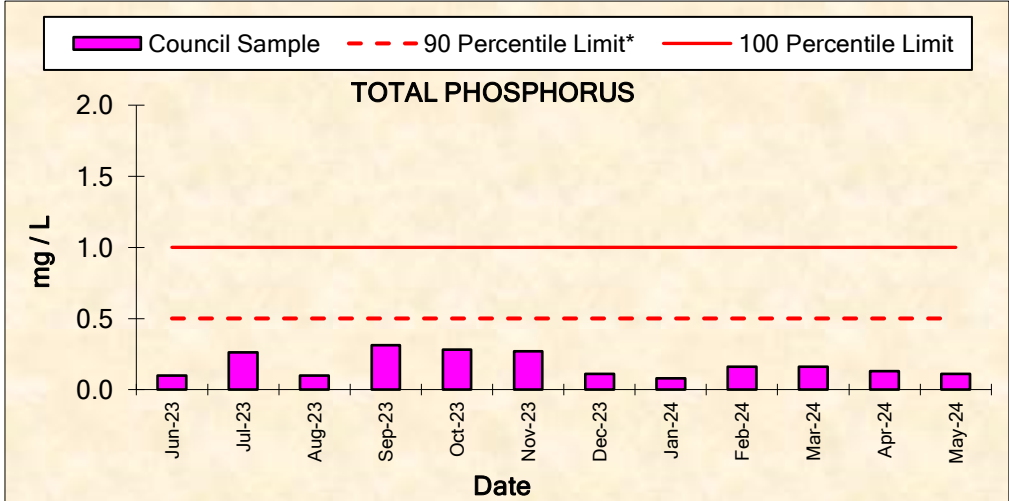


TOTAL SUSPENDED SOLIDS

Frequency	Date Sample Obtained	Date Result Obtained	Unit of Measurement	90 Percentile Limit*	100 Percentile Limit	Council Sample
Monthly	07-Jun-23	15-Jun-23	milligrams per litre (mg/L)	10	15	2
Monthly	05-Jul-23	12-Jul-23	milligrams per litre (mg/L)	10	15	7
Monthly	02-Aug-23	10-Aug-23	milligrams per litre (mg/L)	10	15	4
Monthly	06-Sep-23	13-Sep-23	milligrams per litre (mg/L)	10	15	1
Monthly	04-Oct-23	11-Oct-23	milligrams per litre (mg/L)	10	15	3
Monthly	01-Nov-23	08-Nov-23	milligrams per litre (mg/L)	10	15	6
Monthly	06-Dec-23	14-Dec-23	milligrams per litre (mg/L)	10	15	<1
Monthly	10-Jan-24	18-Jan-24	milligrams per litre (mg/L)	10	15	2
Monthly	21-Feb-24	29-Feb-24	milligrams per litre (mg/L)	10	15	2
Monthly	06-Mar-24	14-Mar-24	milligrams per litre (mg/L)	10	15	1
Monthly	18-Apr-24	24-Apr-24	milligrams per litre (mg/L)	10	15	3
Monthly	01-May-24	09-May-24	milligrams per litre (mg/L)	10	15	1

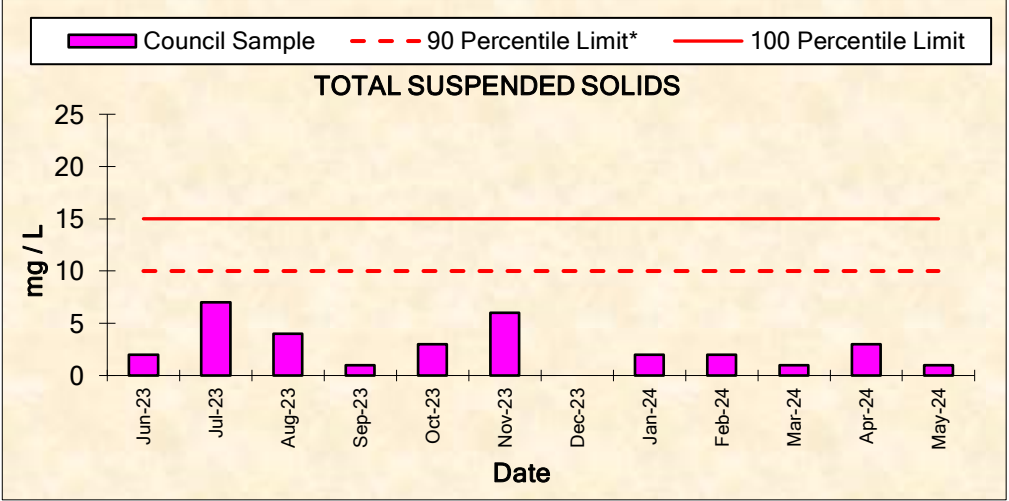


Faecal Coliforms

Frequency	Date Sample Obtained	Date Result Obtained	Unit of Measurement	90 Percentile Limit*	100 Percentile Limit	Council Sample
Monthly	07-Jun-23	15-Jun-23	colony forming units per 100 millilitres (cfu/100mL)	200	600	<1
Monthly	05-Jul-23	12-Jul-23	colony forming units per 100 millilitres (cfu/100mL)	200	600	~5
Monthly	02-Aug-23	10-Aug-23	colony forming units per 100 millilitres (cfu/100mL)	200	600	<1
Monthly	06-Sep-23	13-Sep-23	colony forming units per 100 millilitres (cfu/100mL)	200	600	~7
Monthly	04-Oct-23	11-Oct-23	colony forming units per 100 millilitres (cfu/100mL)	200	600	<1
Monthly	01-Nov-23	08-Nov-23	colony forming units per 100 millilitres (cfu/100mL)	200	600	<1
Monthly	06-Dec-23	14-Dec-23	colony forming units per 100 millilitres (cfu/100mL)	200	600	<1
Monthly	10-Jan-24	18-Jan-24	colony forming units per 100 millilitres (cfu/100mL)	200	600	<1
Monthly	21-Feb-24	29-Feb-24	colony forming units per 100 millilitres (cfu/100mL)	200	600	<1
Monthly	06-Mar-24	14-Mar-24	colony forming units per 100 millilitres (cfu/100mL)	200	600	~1
Monthly	18-Apr-24	24-Apr-24	colony forming units per 100 millilitres (cfu/100mL)	200	600	<1
Monthly	01-May-24	09-May-24	colony forming units per 100 millilitres (cfu/100mL)	200	600	<1

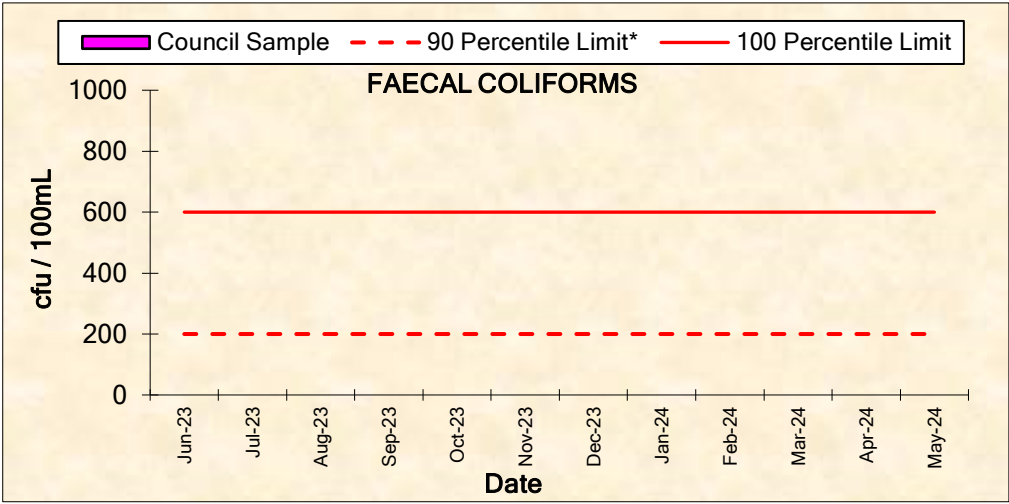


pH

Frequency	Date Sample Obtained	Date Result Obtained	Unit of Measurement		100 Percentile Limit	Council Sample
Monthly	07-Jun-23	15-Jun-23	pH		6.5-8.5	7.2
Monthly	05-Jul-23	12-Jul-23	pH		6.5-8.5	7.2
Monthly	02-Aug-23	10-Aug-23	pH		6.5-8.5	7.2
Monthly	06-Sep-23	13-Sep-23	pH		6.5-8.5	7.4
Monthly	04-Oct-23	11-Oct-23	pH		6.5-8.5	7.0
Monthly	01-Nov-23	08-Nov-23	pH		6.5-8.5	7.3
Monthly	06-Dec-23	14-Dec-23	pH		6.5-8.5	7.4
Monthly	10-Jan-24	18-Jan-24	pH		6.5-8.5	7.0
Monthly	21-Feb-24	29-Feb-24	pH		6.5-8.5	7.0
Monthly	06-Mar-24	14-Mar-24	pH		6.5-8.5	6.8
Monthly	18-Apr-24	24-Apr-24	pH		6.5-8.5	7.1
Monthly	01-May-24	09-May-24	pH		6.5-8.5	7.3

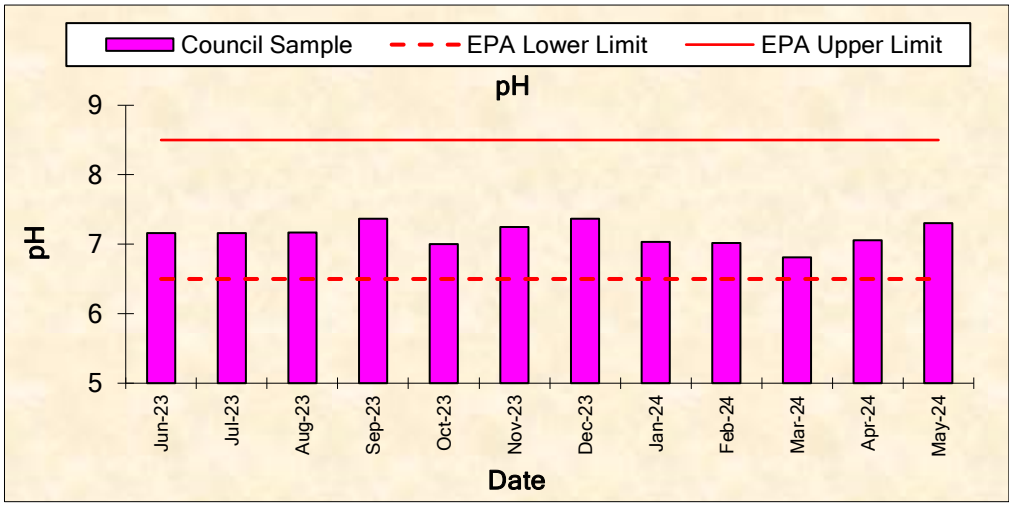

AMMONIA NITROGEN

Frequency	Date Sample Obtained	Date Result Obtained	Unit of Measurement	90 Percentile Limit*	100 Percentile Limit	Council Sample
Monthly	07-Jun-23	15-Jun-23	milligrams per litre (mg/L)	2	5	0.11
Monthly	05-Jul-23	12-Jul-23	milligrams per litre (mg/L)	2	5	0.13
Monthly	02-Aug-23	10-Aug-23	milligrams per litre (mg/L)	2	5	0.26
Monthly	06-Sep-23	13-Sep-23	milligrams per litre (mg/L)	2	5	0.18
Monthly	04-Oct-23	11-Oct-23	milligrams per litre (mg/L)	2	5	0.10
Monthly	01-Nov-23	08-Nov-23	milligrams per litre (mg/L)	2	5	0.02
Monthly	06-Dec-23	14-Dec-23	milligrams per litre (mg/L)	2	5	0.36
Monthly	10-Jan-24	18-Jan-24	milligrams per litre (mg/L)	2	5	0.25
Monthly	21-Feb-24	29-Feb-24	milligrams per litre (mg/L)	2	5	0.08
Monthly	06-Mar-24	14-Mar-24	milligrams per litre (mg/L)	2	5	0.03
Monthly	18-Apr-24	24-Apr-24	milligrams per litre (mg/L)	2	5	0.04
Monthly	01-May-24	09-May-24	milligrams per litre (mg/L)	2	5	0.03

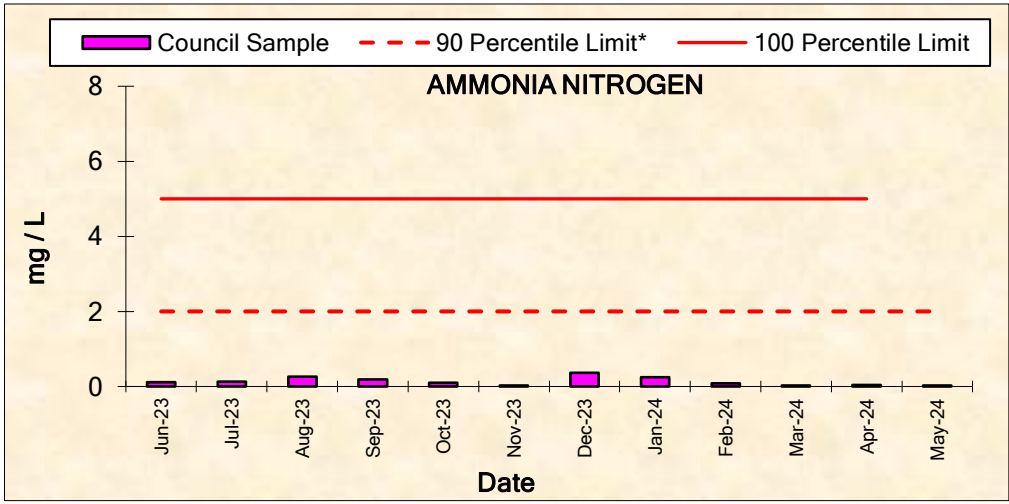

* Note: 90th percentile limit compliance calculated on an annual basis

non-compliance notes: