




Licensee: Shoalhaven City Council, Shoalhaven Water, PO Box 42 Nowra 2541  
Environmental Protection License No. 1735  
EPA ID No. 5

Bomaderry Wastewater Treatment Plant - Monitoring Summary


BOD

| Frequency | Date Sample Obtained | Date Result Obtained | Unit of Measurement         | 90th Percentile Limit* | 100th Percentile Limit* | Sample Result |
|-----------|----------------------|----------------------|-----------------------------|------------------------|-------------------------|---------------|
| Monthly   | 04-Jun-25            | 11-Jun-25            | milligrams per litre (mg/L) | 10                     | 15                      | 5             |
| Monthly   | 21-Jul-25            | 28-Jul-25            | milligrams per litre (mg/L) | 10                     | 15                      | 4             |
| Monthly   | 12-Aug-25            | 19-Aug-25            | milligrams per litre (mg/L) | 10                     | 15                      | <2            |
| Monthly   | 17-Sep-25            | 24-Sep-25            | milligrams per litre (mg/L) | 10                     | 15                      | <2            |
| Monthly   | 01-Oct-25            | 08-Oct-25            | milligrams per litre (mg/L) | 10                     | 15                      | <2            |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 10                     | 15                      |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 10                     | 15                      |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 10                     | 15                      |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 10                     | 15                      |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 10                     | 15                      |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 10                     | 15                      |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 10                     | 15                      |               |

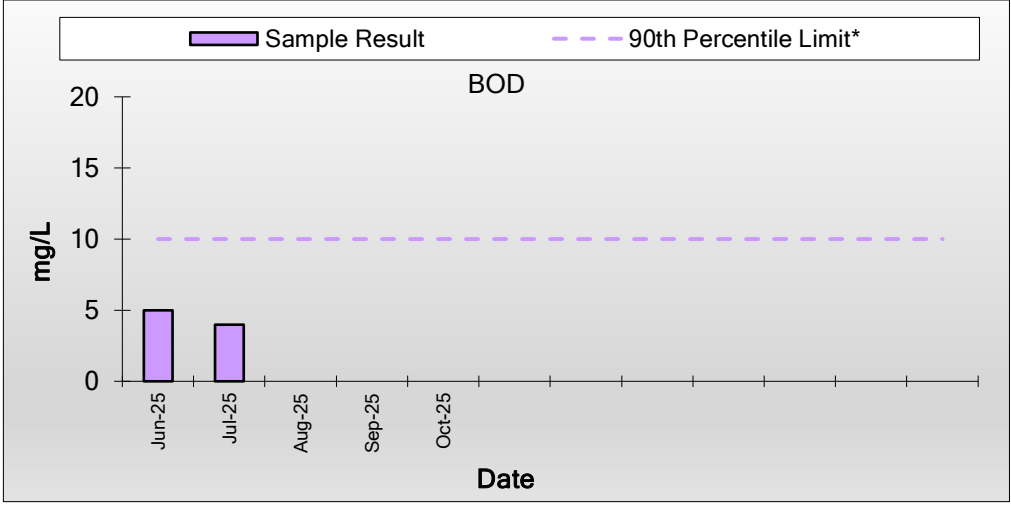


FAECAL COLIFORMS

| Frequency | Date Sample Obtained | Date Result Obtained | Unit of Measurement                                  | 90th Percentile Limit* | 100th Percentile Limit* | Sample Result |
|-----------|----------------------|----------------------|------------------------------------------------------|------------------------|-------------------------|---------------|
| Monthly   | 04-Jun-25            | 11-Jun-25            | colony forming units per 100 millilitres (cfu/100mL) | 150                    | 500                     | 15            |
| Monthly   | 21-Jul-25            | 28-Jul-25            | colony forming units per 100 millilitres (cfu/100mL) | 150                    | 500                     | 5             |
| Monthly   | 12-Aug-25            | 19-Aug-25            | colony forming units per 100 millilitres (cfu/100mL) | 150                    | 500                     | 4             |
| Monthly   | 17-Sep-25            | 24-Sep-25            | colony forming units per 100 millilitres (cfu/100mL) | 150                    | 500                     | 7             |
| Monthly   | 01-Oct-25            | 08-Oct-25            | colony forming units per 100 millilitres (cfu/100mL) | 150                    | 500                     | 64            |
| Monthly   |                      |                      | colony forming units per 100 millilitres (cfu/100mL) | 150                    | 500                     |               |
| Monthly   |                      |                      | colony forming units per 100 millilitres (cfu/100mL) | 150                    | 500                     |               |
| Monthly   |                      |                      | colony forming units per 100 millilitres (cfu/100mL) | 150                    | 500                     |               |
| Monthly   |                      |                      | colony forming units per 100 millilitres (cfu/100mL) | 150                    | 500                     |               |
| Monthly   |                      |                      | colony forming units per 100 millilitres (cfu/100mL) | 150                    | 500                     |               |
| Monthly   |                      |                      | colony forming units per 100 millilitres (cfu/100mL) | 150                    | 500                     |               |
| Monthly   |                      |                      | colony forming units per 100 millilitres (cfu/100mL) | 150                    | 500                     |               |

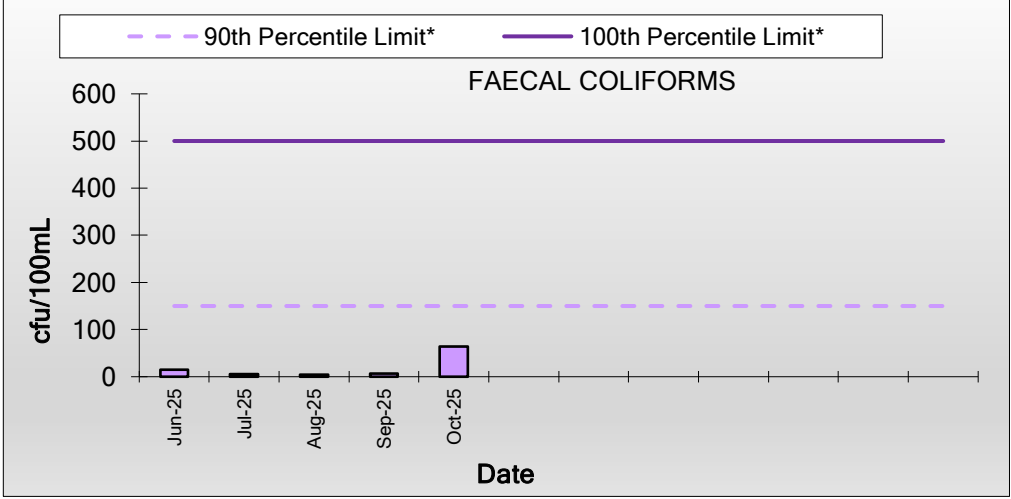


AMMONIA NITROGEN

| Frequency | Date Sample Obtained | Date Result Obtained | Unit of Measurement         | 90th Percentile Limit* | 100th Percentile Limit* | Sample Result |
|-----------|----------------------|----------------------|-----------------------------|------------------------|-------------------------|---------------|
| Monthly   | 04-Jun-25            | 11-Jun-25            | milligrams per litre (mg/L) | 2                      | 5                       | 0.02          |
| Monthly   | 21-Jul-25            | 28-Jul-25            | milligrams per litre (mg/L) | 2                      | 5                       | 0.05          |
| Monthly   | 12-Aug-25            | 19-Aug-25            | milligrams per litre (mg/L) | 2                      | 5                       | 0.03          |
| Monthly   | 17-Sep-25            | 24-Sep-25            | milligrams per litre (mg/L) | 2                      | 5                       | 0.05          |
| Monthly   | 01-Oct-25            | 08-Oct-25            | milligrams per litre (mg/L) | 2                      | 5                       | 0.02          |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 2                      | 5                       |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 2                      | 5                       |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 2                      | 5                       |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 2                      | 5                       |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 2                      | 5                       |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 2                      | 5                       |               |

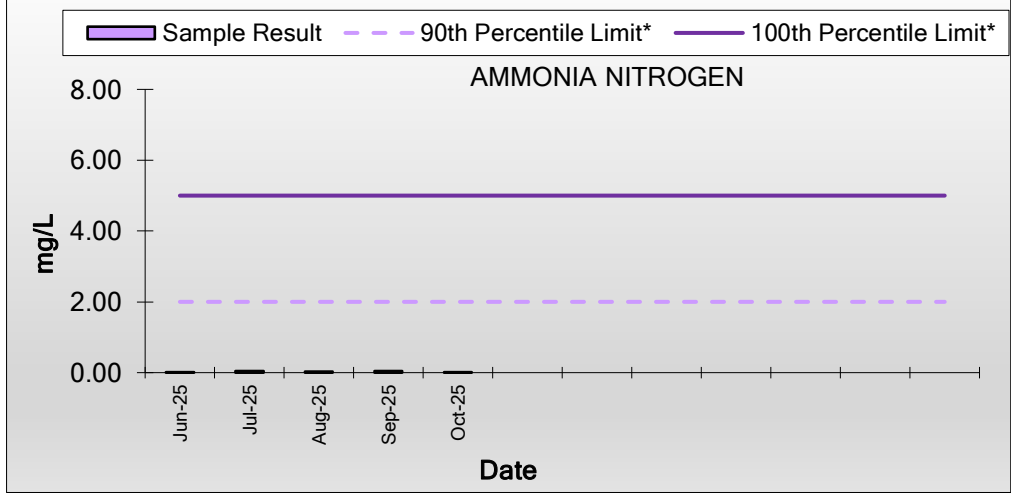


TOTAL NITROGEN

| Frequency | Date Sample Obtained | Date Result Obtained | Unit of Measurement         | 90th Percentile Limit* | 100th Percentile Limit* | Sample Result |
|-----------|----------------------|----------------------|-----------------------------|------------------------|-------------------------|---------------|
| Monthly   | 04-Jun-25            | 11-Jun-25            | milligrams per litre (mg/L) | 10                     | 15                      | 6.7           |
| Monthly   | 21-Jul-25            | 28-Jul-25            | milligrams per litre (mg/L) | 10                     | 15                      | 5.3           |
| Monthly   | 12-Aug-25            | 19-Aug-25            | milligrams per litre (mg/L) | 10                     | 15                      | 5.4           |
| Monthly   | 17-Sep-25            | 24-Sep-25            | milligrams per litre (mg/L) | 10                     | 15                      | 3.8           |
| Monthly   | 01-Oct-25            | 08-Oct-25            | milligrams per litre (mg/L) | 10                     | 15                      | 5.0           |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 10                     | 15                      |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 10                     | 15                      |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 10                     | 15                      |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 10                     | 15                      |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 10                     | 15                      |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 10                     | 15                      |               |

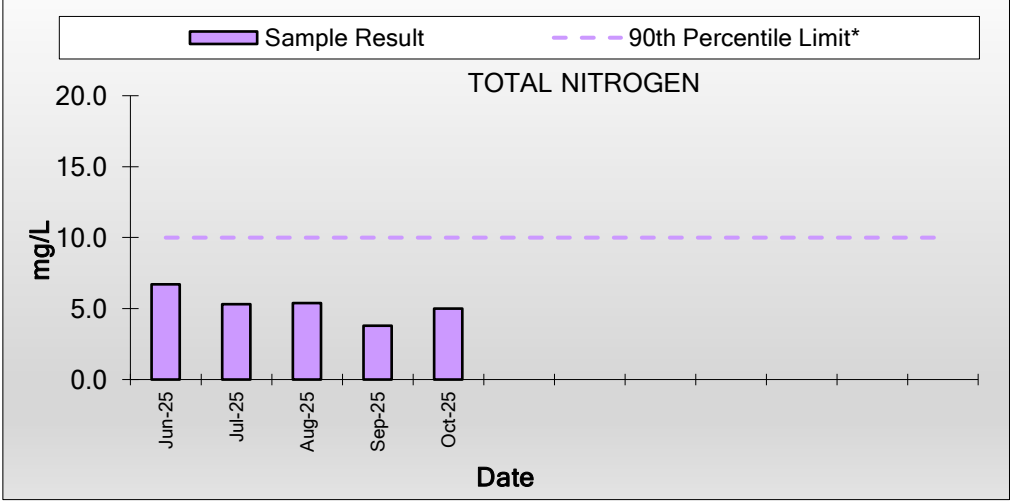


OIL AND GREASE

| Frequency | Date Sample Obtained | Date Result Obtained | Unit of Measurement         | 90th Percentile Limit* | 100th Percentile Limit* | Sample Result |
|-----------|----------------------|----------------------|-----------------------------|------------------------|-------------------------|---------------|
| Monthly   | 04-Jun-25            | 11-Jun-25            | milligrams per litre (mg/L) | 2                      | 10                      | <1            |
| Monthly   | 21-Jul-25            | 28-Jul-25            | milligrams per litre (mg/L) | 2                      | 10                      | <1            |
| Monthly   | 12-Aug-25            | 19-Aug-25            | milligrams per litre (mg/L) | 2                      | 10                      | <1            |
| Monthly   | 17-Sep-25            | 24-Sep-25            | milligrams per litre (mg/L) | 2                      | 10                      | <1            |
| Monthly   | 01-Oct-25            | 08-Oct-25            | milligrams per litre (mg/L) | 2                      | 10                      | <1            |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 2                      | 10                      |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 2                      | 10                      |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 2                      | 10                      |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 2                      | 10                      |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 2                      | 10                      |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 2                      | 10                      |               |

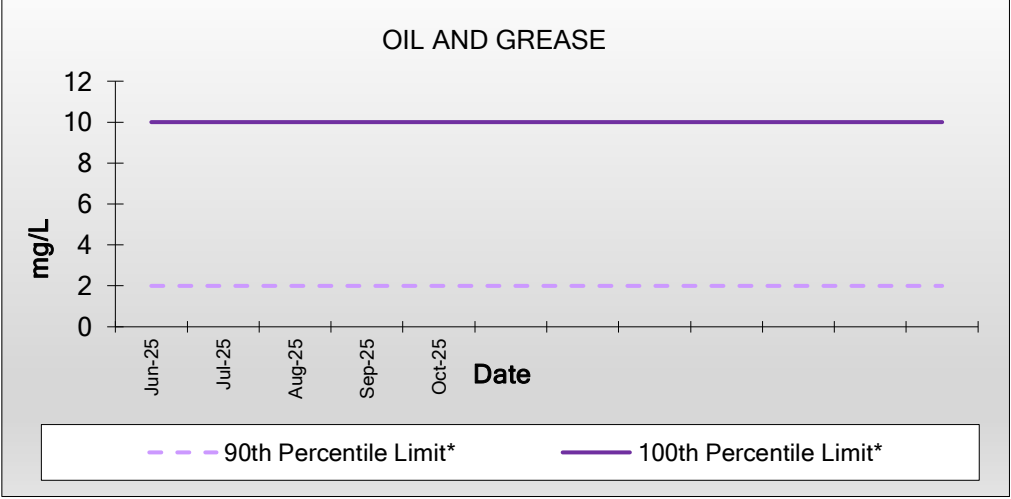


pH

| Frequency | Date Sample Obtained | Date Result Obtained | Unit of Measurement | 100th Percentile Limit | Sample Result |
|-----------|----------------------|----------------------|---------------------|------------------------|---------------|
| Monthly   | 04-Jun-25            | 11-Jun-25            | pH                  | 6.5 - 8.5              | 7.0           |
| Monthly   | 21-Jul-25            | 28-Jul-25            | pH                  | 6.5 - 8.5              | 7.1           |
| Monthly   | 12-Aug-25            | 19-Aug-25            | pH                  | 6.5 - 8.5              | 6.8           |
| Monthly   | 17-Sep-25            | 24-Sep-25            | pH                  | 6.5 - 8.5              | 6.3           |
| Monthly   | 01-Oct-25            | 08-Oct-25            | pH                  | 6.5 - 8.5              | 6.9           |
| Monthly   |                      |                      | pH                  | 6.5 - 8.5              |               |
| Monthly   |                      |                      | pH                  | 6.5 - 8.5              |               |
| Monthly   |                      |                      | pH                  | 6.5 - 8.5              |               |
| Monthly   |                      |                      | pH                  | 6.5 - 8.5              |               |
| Monthly   |                      |                      | pH                  | 6.5 - 8.5              |               |
| Monthly   |                      |                      | pH                  | 6.5 - 8.5              |               |
| Monthly   |                      |                      | pH                  | 6.5 - 8.5              |               |

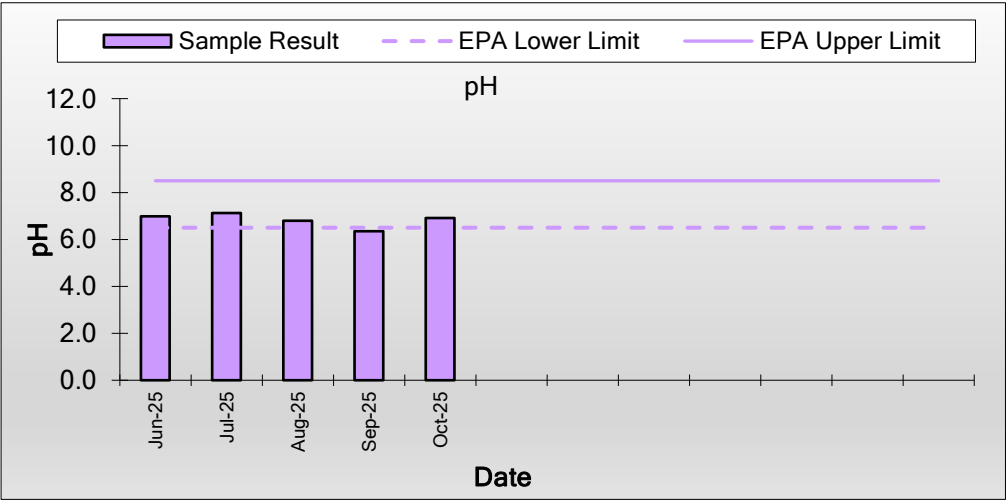


TOTAL PHOSPHORUS

| Frequency | Date Sample Obtained | Date Result Obtained | Unit of Measurement         | 90th Percentile Limit* | 100th Percentile Limit* | Sample Result |
|-----------|----------------------|----------------------|-----------------------------|------------------------|-------------------------|---------------|
| Monthly   | 04-Jun-25            | 11-Jun-25            | milligrams per litre (mg/L) | 0.5                    | 1.0                     | 0.07          |
| Monthly   | 21-Jul-25            | 28-Jul-25            | milligrams per litre (mg/L) | 0.5                    | 1.0                     | 0.42          |
| Monthly   | 12-Aug-25            | 19-Aug-25            | milligrams per litre (mg/L) | 0.5                    | 1.0                     | 0.20          |
| Monthly   | 17-Sep-25            | 24-Sep-25            | milligrams per litre (mg/L) | 0.5                    | 1.0                     | 0.05          |
| Monthly   | 01-Oct-25            | 08-Oct-25            | milligrams per litre (mg/L) | 0.5                    | 1.0                     | 0.01          |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 0.5                    | 1.0                     |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 0.5                    | 1.0                     |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 0.5                    | 1.0                     |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 0.5                    | 1.0                     |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 0.5                    | 1.0                     |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 0.5                    | 1.0                     |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 0.5                    | 1.0                     |               |

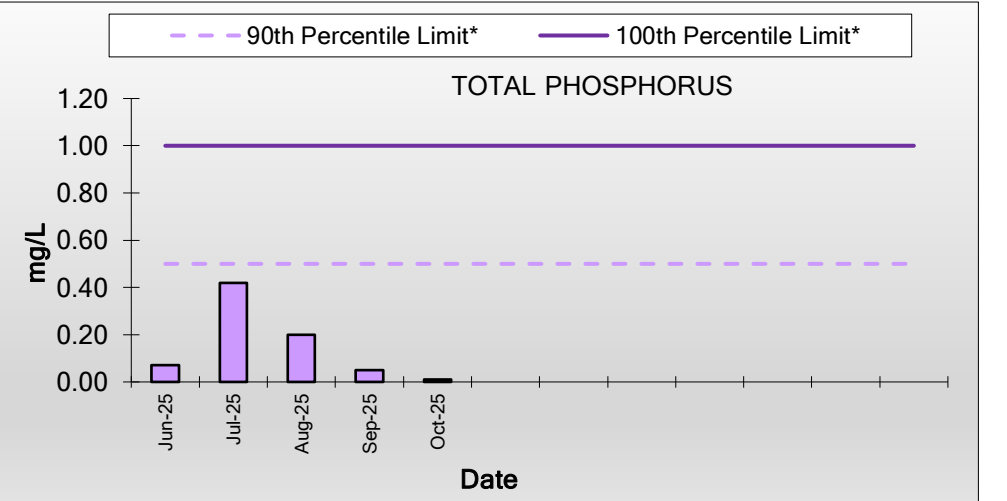

TOTAL SUSPENDED SOLIDS

| Frequency | Date Sample Obtained | Date Result Obtained | Unit of Measurement         | 90th Percentile Limit* | 100th Percentile Limit* | Sample Result |
|-----------|----------------------|----------------------|-----------------------------|------------------------|-------------------------|---------------|
| Monthly   | 04-Jun-25            | 11-Jun-25            | milligrams per litre (mg/L) | 10                     | 15                      | 1             |
| Monthly   | 21-Jul-25            | 28-Jul-25            | milligrams per litre (mg/L) | 10                     | 15                      | <1            |
| Monthly   | 12-Aug-25            | 19-Aug-25            | milligrams per litre (mg/L) | 10                     | 15                      | 1             |
| Monthly   | 17-Sep-25            | 24-Sep-25            | milligrams per litre (mg/L) | 10                     | 15                      | <1            |
| Monthly   | 01-Oct-25            | 08-Oct-25            | milligrams per litre (mg/L) | 10                     | 15                      | <1            |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 10                     | 15                      |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 10                     | 15                      |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 10                     | 15                      |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 10                     | 15                      |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 10                     | 15                      |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 10                     | 15                      |               |
| Monthly   |                      |                      | milligrams per litre (mg/L) | 10                     | 15                      |               |

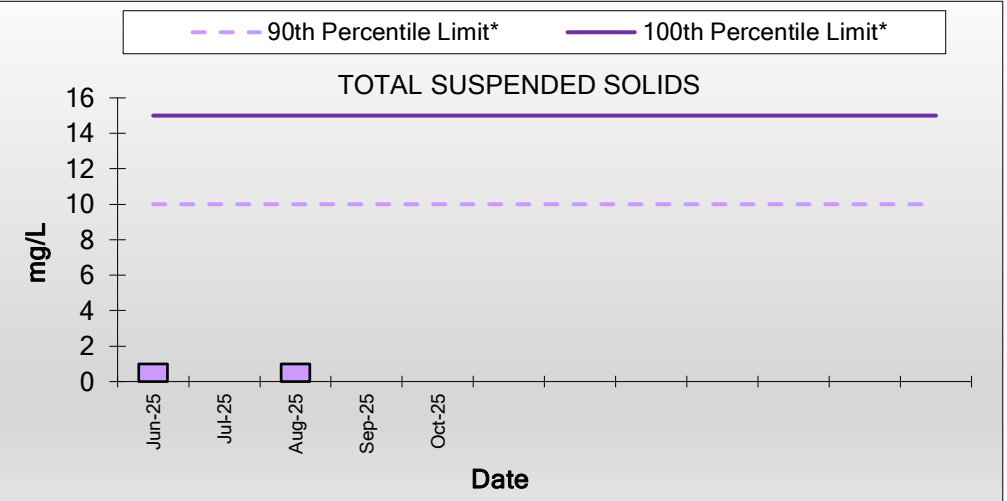


\* Note: 90th and 100th percentile limit compliance calculated on an annual basis

non-compliance notes:




pH

| Frequency | Date Sample Obtained | Date Result Obtained | Unit of Measurement | EPA Limit  | Sample Result |
|-----------|----------------------|----------------------|---------------------|------------|---------------|
| Monthly   | 04-Jun-25            | no discharge         | pH                  | MONITORING | NA            |
| Monthly   | 21-Jul-25            | no discharge         | pH                  |            | NA            |
| Monthly   | 12-Aug-25            | no discharge         | pH                  |            | NA            |
| Monthly   | 17-Sep-25            | no discharge         | pH                  |            | NA            |
| Monthly   | 01-Oct-25            | no discharge         | pH                  |            | NA            |
| Monthly   |                      |                      | pH                  | CONDITION  |               |
| Monthly   |                      |                      | pH                  |            |               |
| Monthly   |                      |                      | pH                  |            |               |
| Monthly   |                      |                      | pH                  |            |               |
| Monthly   |                      |                      | pH                  |            |               |
| Monthly   |                      |                      | pH                  |            |               |
| Monthly   |                      |                      | pH                  |            |               |
| Monthly   |                      |                      | pH                  |            |               |

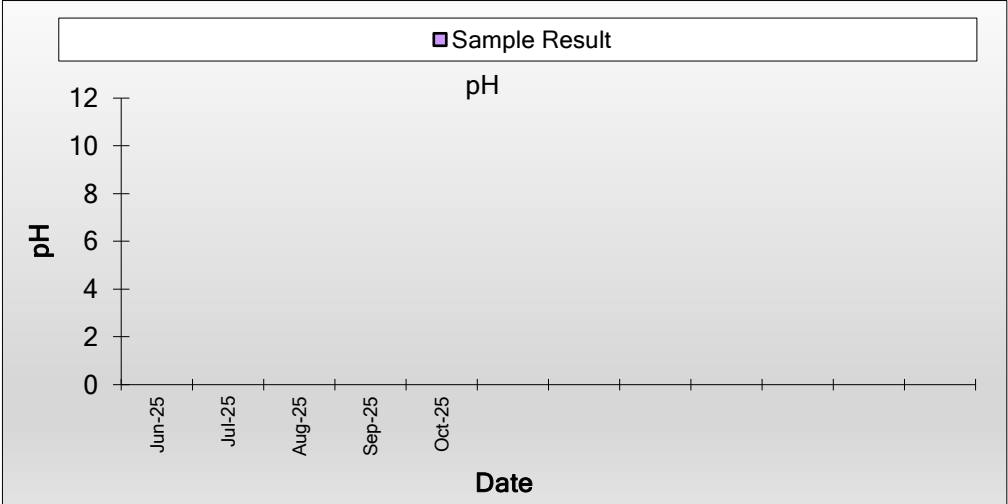


TOTAL PHOSPHORUS

| Frequency | Date Sample Obtained | Date Result Obtained | Unit of Measurement        | EPA Limit  | Sample Result |
|-----------|----------------------|----------------------|----------------------------|------------|---------------|
| Monthly   | 04-Jun-25            | no discharge         | miligrams per litre (mg/L) | MONITORING | NA            |
| Monthly   | 09-Jul-25            | no discharge         | miligrams per litre (mg/L) |            | NA            |
| Monthly   | 12-Aug-25            | no discharge         | miligrams per litre (mg/L) |            | NA            |
| Monthly   | 17-Sep-25            | no discharge         | miligrams per litre (mg/L) |            | NA            |
| Monthly   | 01-Oct-25            | no discharge         | miligrams per litre (mg/L) |            | NA            |
| Monthly   |                      |                      | miligrams per litre (mg/L) | CONDITION  |               |
| Monthly   |                      |                      | miligrams per litre (mg/L) |            |               |
| Monthly   |                      |                      | miligrams per litre (mg/L) |            |               |
| Monthly   |                      |                      | miligrams per litre (mg/L) |            |               |
| Monthly   |                      |                      | miligrams per litre (mg/L) |            |               |
| Monthly   |                      |                      | miligrams per litre (mg/L) |            |               |
| Monthly   |                      |                      | miligrams per litre (mg/L) |            |               |
| Monthly   |                      |                      | miligrams per litre (mg/L) |            |               |

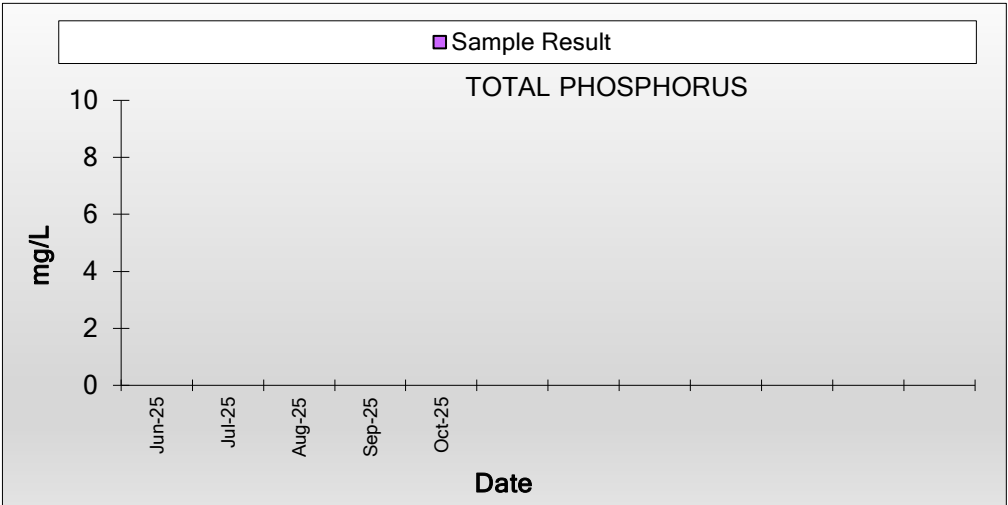

TOTAL SUSPENDED SOLIDS

| Frequency | Date Sample Obtained | Date Result Obtained | Unit of Measurement        | EPA Limit  | Sample Result |
|-----------|----------------------|----------------------|----------------------------|------------|---------------|
| Monthly   | 04-Jun-25            | no discharge         | miligrams per litre (mg/L) | MONITORING | NA            |
| Monthly   | 21-Jul-25            | no discharge         | miligrams per litre (mg/L) |            | NA            |
| Monthly   | 12-Aug-25            | no discharge         | miligrams per litre (mg/L) |            | NA            |
| Monthly   | 17-Sep-25            | no discharge         | miligrams per litre (mg/L) |            | NA            |
| Monthly   | 01-Oct-25            | no discharge         | miligrams per litre (mg/L) |            | NA            |
| Monthly   |                      |                      | miligrams per litre (mg/L) | CONDITION  |               |
| Monthly   |                      |                      | miligrams per litre (mg/L) |            |               |
| Monthly   |                      |                      | miligrams per litre (mg/L) |            |               |
| Monthly   |                      |                      | miligrams per litre (mg/L) |            |               |
| Monthly   |                      |                      | miligrams per litre (mg/L) |            |               |
| Monthly   |                      |                      | miligrams per litre (mg/L) |            |               |
| Monthly   |                      |                      | miligrams per litre (mg/L) |            |               |
| Monthly   |                      |                      | miligrams per litre (mg/L) |            |               |

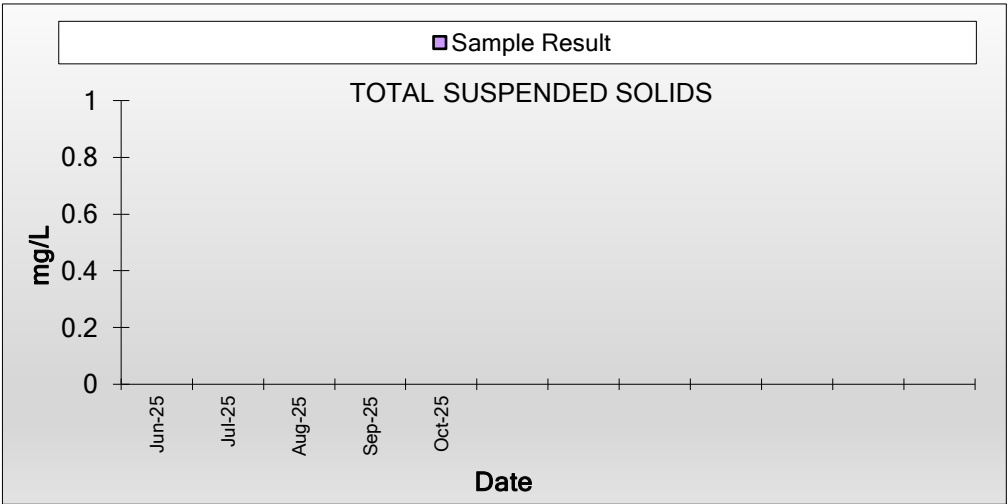

non-compliance notes: