


SAMPLE WATER MARKERS

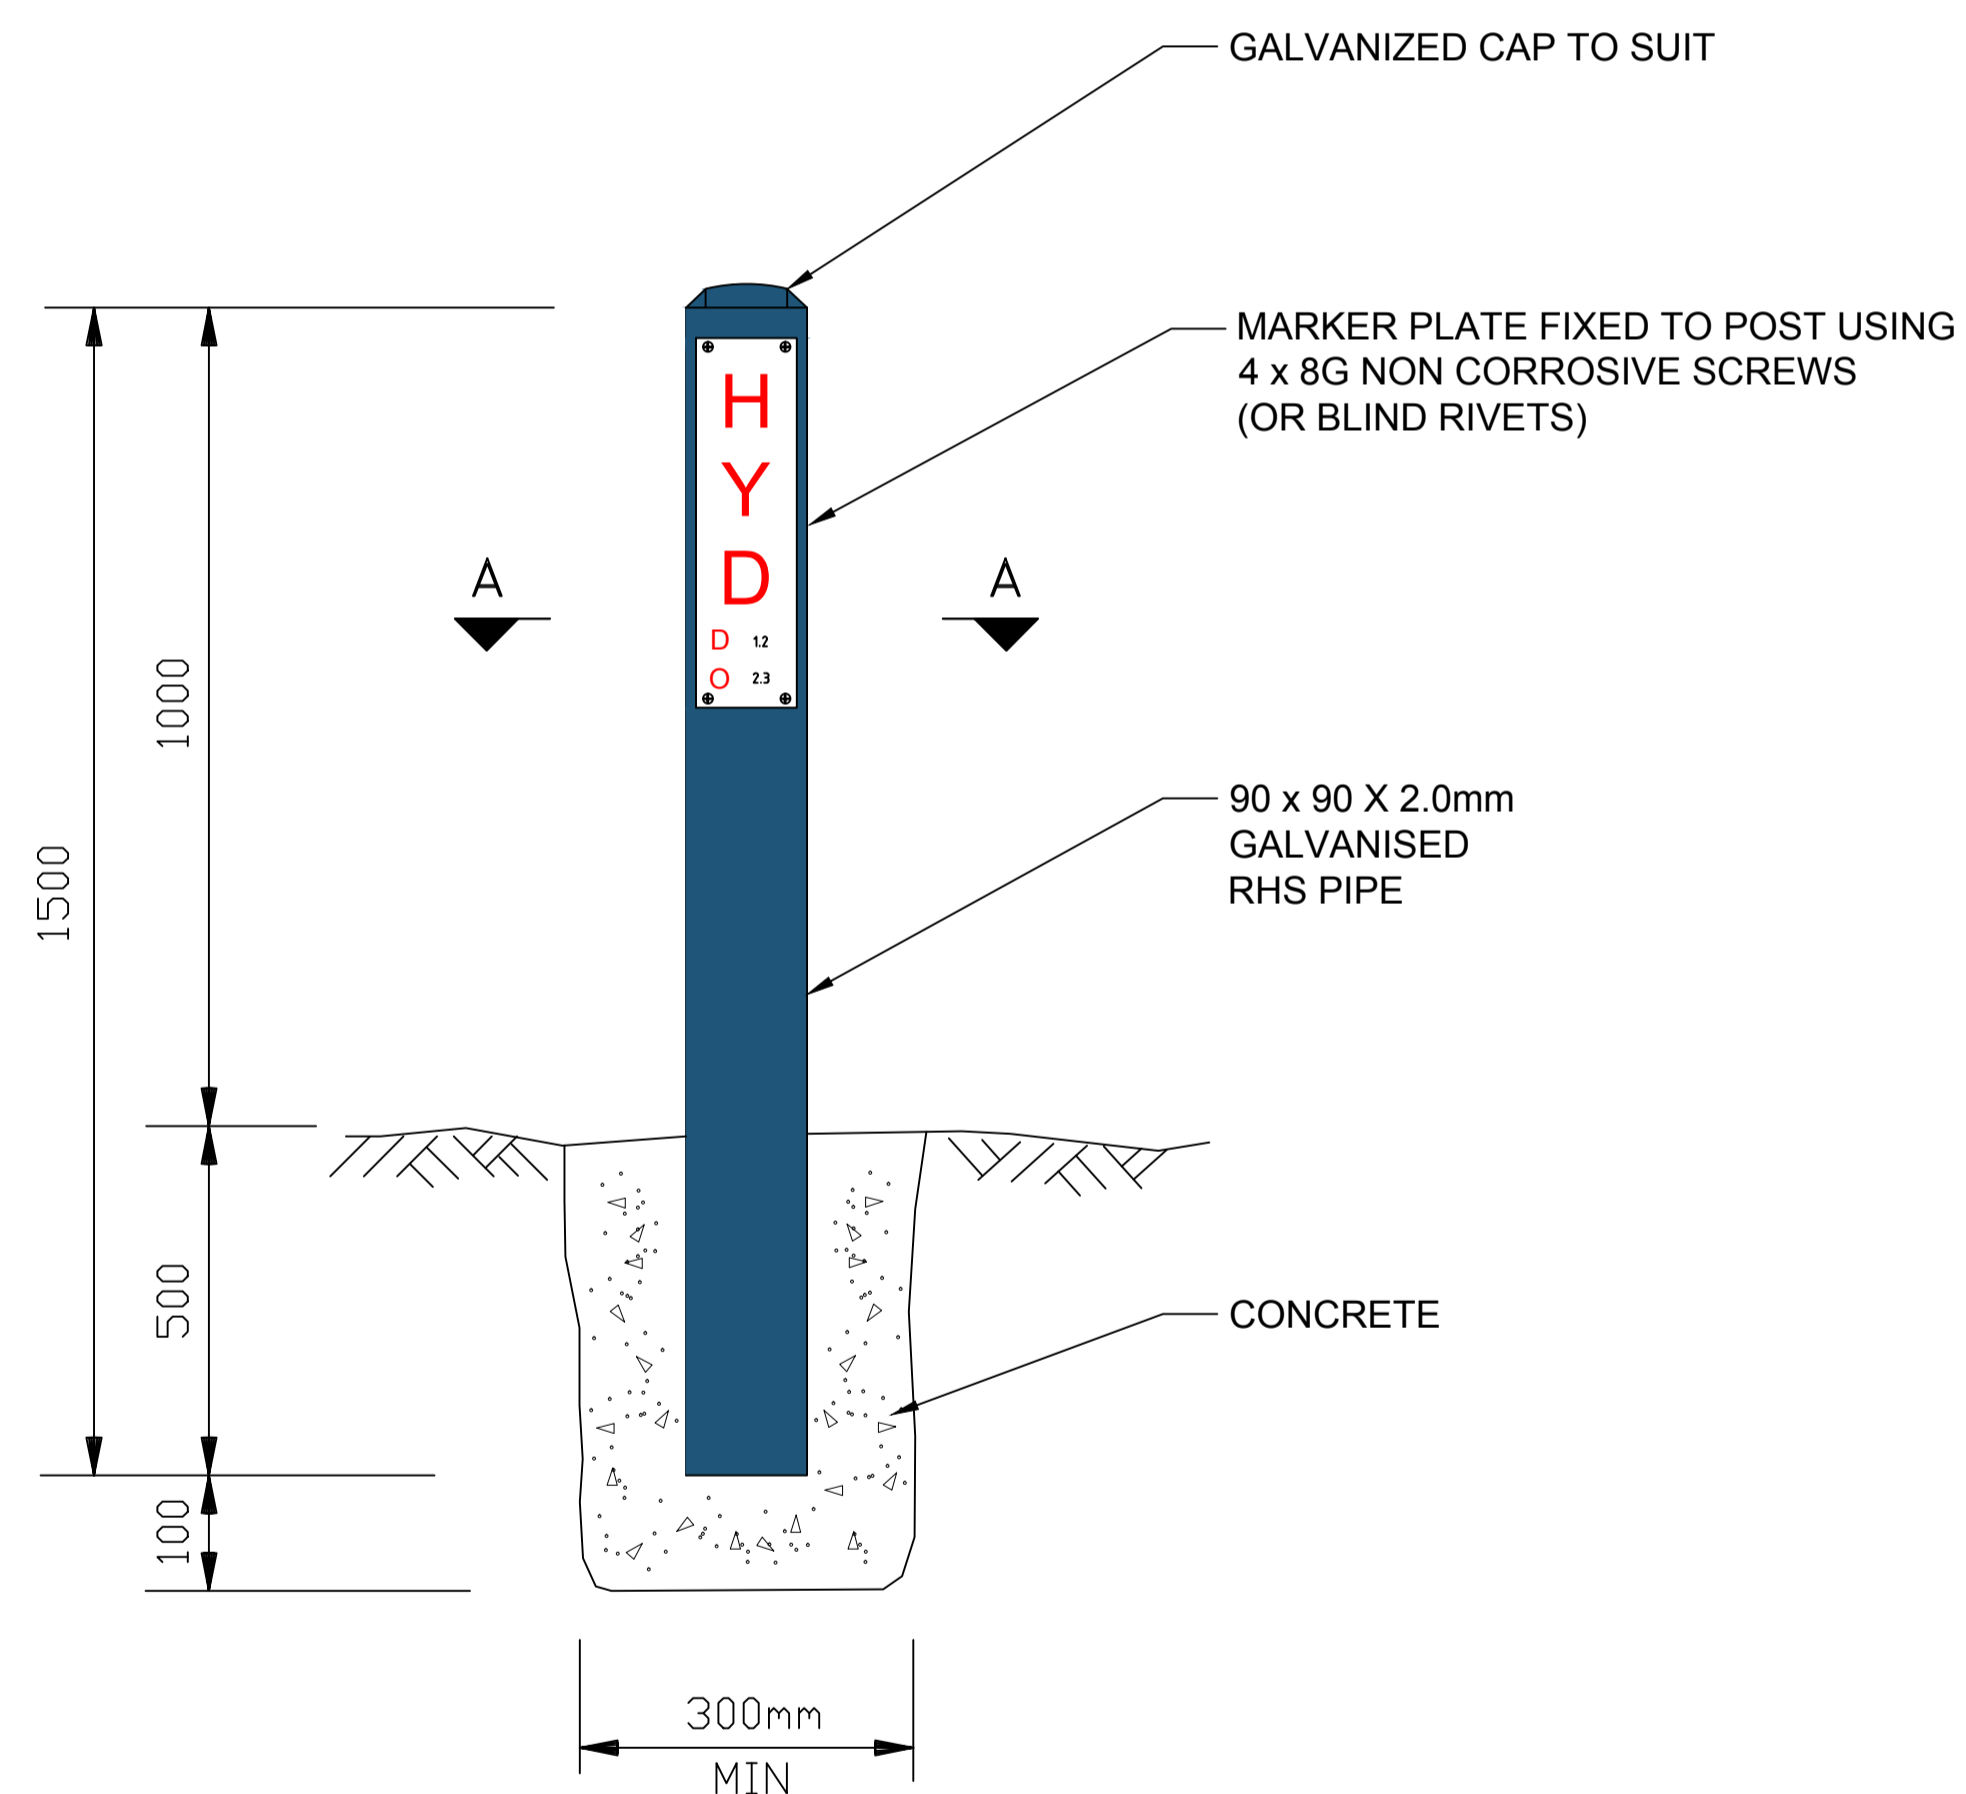

NOTE:

POSTS TO BE-

- GALVANISED 90 x 90 x 2mm AND A MINIMUM OF 1.5m LONG
- A MINIMUM OF 1.0m ABOVE FSL AND A MINIMUM OF 0.5m SET IN CONCRETE
- CAPPED AND PAINTED MID BLUE (B51 to AS 2700)

MARKERS TO BE-

- 275 x 75 x 1.5mm ALUMINIUM PLATE
- STAMPED WITH ADDITIONAL INFORMATION AS REQUIRED (OFF SET, DEPTH, ANGLE OF BEND) USING A SET OF METAL PUNCH
- FIXED TO EITHER-
  - A STANDARD MARKER POST USING 4 x 8g NON CORROSIVE (OR BLIND RIVETS)
  - OR
  - A CLOSE PERMANENT STRUCTURE (POWER POLE, ETC) USING NON CORROSIVE SCREWS AT A MINIMUM HEIGHT OF 1 METRE

BK	DETAILS OF AMENDMENTS	INIT.	DATE
A	CONCRETE POST TO GALVANIZED POST	R.D.	07-08-12
B	PAINT CODE TYPO (from 15 to 51)	R.D.	12-10-16

REDUCTION RATIO	N.T.S.
-----------------	--------

ALL LEVELS ARE IN METRES  
ALL CHAINAGES ARE IN METRES ALL OTHER DIMENSIONS ARE IN MILLIMETRES UNLESS SHOWN OTHERWISE

DESIGNED: R.D.	FIELD BOOK: NA	ORIGIN OF LEVELS: NA
SURVEYED: NA	LEVEL BOOK: NA	AZIMUTH: NA
DRAWN: R.D.	DATUM: NA	DRAWING FILE: 25350-50a DWG
DATE: AUG 2012	CHECKED: D.B.	REFERENCE FILE: 999 A1 Frame

**Shoalhaven Water**  
A Group of Shoalhaven City Council

DIRECTOR, SHOALHAVEN WATER

PLANNING & DEVELOPMENT MANAGER

WATER STANDARD DRAWING  
ARRANGEMENT FOR  
MARKER POSTS AND  
PLATES

FILE NO:	W20855-005
PLAN SIZE:	A3
REVISION NO.:	B
PLAN REFERENCE:	